



GREEN AREA RATIO GUIDEBOOK

November 2017

Department of Energy and Environment
Natural Resources Administration
Regulatory Review Division
1200 First Street NE, 5th Floor
Washington, DC 20002

www.doe.dc.gov/gar

Acknowledgements

An undertaking such as the Green Area Ratio (GAR) Guidebook requires the dedication and cooperative efforts of many individuals. Laine Cidlowksi (Office of Planning) authored the GAR regulation in cooperation with the Office of Zoning. At the Department of Energy and Environment (DOEE), Dr. Hamid Karimi, Deputy Director of Natural Resources; Sheila Besse, Associate Director of Watershed Protection; Walter Caldwell, Branch Chief of Construction and Maintenance; Brian VanWye, Associate Director of Regulatory Review Division; and Timothy Karikari, Branch Chief of Building Permit Plan Review, deserve credit for their overall leadership and support of this project.

Project Manager

Margaret Noonan, DOEE-Building Permit Plan Review

Lead Authors

Markku McGlynn, formerly with DOEE-Construction and Maintenance
Margaret Noonan, DOEE-Building Permit Plan Review
Laine Cidlowksi, Office of Planning
Rebecca C. Stack, formerly with DOEE-Technical Services
David Wooden, formerly with DOEE-Restoration

Editor

Sherry Schwechten, DOEE-Natural Resources

Contributors and Peer Reviewers

Julienne Bautista, DOEE-Building Permit Plan Review
Sarah Bouldin-Carr, Office of Zoning Administrator
Josh Burch, DOEE-Restoration
Walter Caldwell, DOEE-Construction and Maintenance
Elias Demessie, DOEE-Building Permit Plan Review
James Dunbar, DOEE-Building Permit Plan Review
Matthew Espie, DOEE-Water Resource Protection and Mitigation
Laura Gardner, Center for Watershed Protection
Shawn Gibbs, Office of the Zoning Administrator
Alisha Goldstein, formerly with DOEE-Building Permit Plan Review
Dillon Goodell, DOEE-Building Permit Plan Review
Liz Guthrie, American Society of Landscape Architects
Stephen Gyor, Office of Planning
Greg Hoffman, P.E., Center for Watershed Protection
Timothy Karikari, P.E., CPESC, CFM, DOEE-Building Permit Plan Review
Emil King, DOEE-Energy Administration

Leah Lemoine, formerly with DOEE-Planning and Restoration
Stephen Reiling, DOEE- Restoration
Emily Rice, DOEE-Partnering and Environmental Conservation
Matthew Robinson, DOEE-Partnering and Environmental Conservation
Steve Saari, DOEE- Restoration
Brian VanWye, DOEE-Regulatory Review Division
Aaron Waters, DOEE-Partnering and Environmental Conservation
Daniel White, DOEE-Utilities Management
Jay Wilson, DOEE-Urban Sustainability Administration

Contents

Acknowledgements	i
Chapter 1 Introduction to the Green Area Ratio	1
Chapter 2 When Regulations Apply	3
Chapter 3 Calculating the Green Area Ratio Score.....	9
Chapter 4 Administration - Plan Development, Construction, and Maintenance	15
Chapter 5 Landscape Elements	25
5.1 Soils and Amendments.....	29
5.2 Bioretention	39
5.3 New and Existing Plantings	44
5.4 Tree Preservation.....	53
5.5 Vegetated Walls	59
5.6 Vegetated Roofs.....	63
5.7 Permeable Paving.....	69
5.8 Enhanced Tree Growth Systems	73
5.9 Renewable Energy.....	77
5.10 Water Features	83
5.11 Native Plants	87
5.12 Food Cultivation	91
5.13 Harvested Stormwater Irrigation	93
Chapter 6 Landscape Maintenance Plan	99
Appendix A Forms.....	A-1
Appendix B Map of Central Employment Area	B-1
Appendix C Glossary	C-1

Chapter 1 Introduction to the Green Area Ratio

INTRODUCTION

Conventional urban site design too often favors use of impervious surface at the expense of vegetation and other green infrastructure alternatives. Extensive hardscape surfaces in urban areas are known to raise ambient temperatures above those of the surrounding region. Increased temperatures lead to increased production of ground-level ozone, which triggers air quality health alerts. Air quality may also be impaired by particulate matter and combustion emissions. Waterbodies can be degraded by pollutants and erosion associated with increased stormwater runoff.

The Green Area Ratio (GAR) is a zoning regulation that integrates landscape elements into parcel site design to promote sustainable and aesthetically pleasing development. GAR sets minimum lot-coverage standards for landscape and site design features to promote greater livability, ecological function, green space accessibility and climate adaptation in the urban environment.

GAR assigns a weighted score to development sites based on the types of landscape and site design features that are implemented and the amount of area they cover. The minimum required GAR score needed to reach compliance differs by zoning district. This score is based on an assessment of the square footage of landscape elements that can be incorporated with each type of land use.

With limited exceptions, sites that require a Certificate of Occupancy must submit a GAR plan as part of the building permit application. These sites include new building construction as well as additions and interior renovations where the cost of work exceeds 100% of the assessed building value.

PURPOSE AND SCOPE

The purpose of the GAR Guidebook is to provide technical guidelines to aid building permit applicants, Certified Landscape Experts, and property owners in complying with the requirements of the GAR zoning regulation.

The GAR Guidebook provides direction in the following areas:

- Additional details on specific zoning language
- Plan submission guidelines
- Scoring requirements and worksheets
- Descriptions of landscape and building elements eligible for scoring credit

- Certified Landscape Expert's responsibilities for design, construction, and maintenance
- Property owner's responsibilities for maintenance of landscape elements

DEVELOPMENT OF THE GREEN AREA RATIO

The GAR is inspired by similar programs developed in cities such as Berlin, Germany; Malmo, Sweden; and Seattle, Washington. The environmental performance of each landscape element is quantified by assigning a unique multiplier to each feature. This multiplier gives landscape elements with greater environmental value a higher GAR score per square foot to account for benefits such as climate adaptation, urban heat island mitigation, air quality improvement, and stormwater mitigation.

The Office of Planning spearheaded the passage of GAR through the Zoning Commission, in collaboration with the Department of Energy and Environment (DOEE). The regulation, Subtitle C, Chapter 6 of Title 11 of the District of Columbia Municipal Regulations, was published on July 12, 2013, and established requirements for new plan submittals as of October 1, 2013. The Zoning Regulation Review final rulemaking was published on March 4, 2016, and resulted in additional changes to the regulation. DOEE carries out plan review and inspection on behalf of the Zoning Administrator, who assigns the Certificate of Occupancy to the building permit applicant upon completion of all GAR requirements.

HOW TO ACHIEVE COMPLIANCE

1. Determine the zoning district and required GAR score for the project.
2. Use the GAR Scoresheet (see Appendix A) to calculate the total area of landscape elements necessary to achieve that score. Chapter 5 describes a wide variety of acceptable landscape elements.
3. After developing a design that achieves the minimum required GAR score, submit the required GAR documentation as part of the building permit application.
4. Construct and maintain the project according to the approved plans.

REFERENCES

Keeley, Melissa. September 2011. "The Green Area Ratio: An Urban Site Sustainability Metric." In *Journal of Environmental Planning and Management*.

Landscape Institute. November 2013. *Public Health and Landscape: Creating Healthy Places*. London.

Nowak, David. 2002. *The Effects of Urban Trees on Air Quality*. United States. Department of Agriculture. Forest Service. Syracuse, NY.

Chapter 2 When Regulations Apply

Effective October 1, 2013

NEW BUILDINGS

All new buildings that require a Certificate of Occupancy must meet the appropriate Green Area Ratio (GAR) based on the zoning district.

There is one exemption:

The building is a municipal wastewater facility operated by the District of Columbia Water and Sewer Authority (DC Water).

EXISTING BUILDINGS

A new addition, interior renovation, or both to an existing building requires a GAR when the construction cost of these improvements exceeds 100% of the assessed value of the improvements of the existing building within any 12-month period. Visit the DC Office of Tax and Revenue website to locate the property's improvement assessed value.

Addition includes the extension or increase in floor area or height of an existing building structure

Interior renovation includes the alteration, renovation, or repair to the interior of the existing structure.

Assessed value of the building is based on the value of the improvement set forth in the records of the Office of Tax and Revenue as of the date of the building permit application.

Construction cost for an addition, alteration, or repair to an existing building is the amount indicated by the applicant. Building permit valuations are defined in the DC Building Code.

There are 2 exemptions:

1. The addition is an interior renovation of an existing building located in the Central Employment Area and all of the following criteria apply:
 - The building has an existing 100% lot occupancy prior to filing the building permit;
 - The building has an existing roof that cannot support a dead load of 4 inches of growing media; and

- The work proposed by the building permit application will not result in a roof capable of supporting a dead load of 4 inches of growing media.
- 2. The building is a **historic resource** and the “change of use” or “increase of intensity of use” does not result in an increase to the gross floor area by 50% or more.

However, any approved change or modification to a permit, project, or application that falls into the above categories and results in a 20% or greater increase in impervious surface or lot occupancy causes the GAR to be applicable for the portion of the project affected by the modification (11 DCMR Subtitle C §601.5).

Central Employment Area boundaries are identified in Appendix B.

Historic resource is a building or structure listed in the District of Columbia Inventory of Historic Sites or a building or structure certified in writing by the State Historic Preservation Officer as contributing to the character of the historic district in which it is located.

TRANSITION PERIOD EXEMPTIONS

The GAR regulation adopted provisions to grandfather projects that initiated key steps in the permitting process prior to the October 1, 2013, effective date.

The GAR will not apply to a building permit application for a new building, addition, or interior renovation to an existing building if the building permit plans are consistent with the following conditions:

- a. Officially accepted by the Department of Consumer and Regulatory Affairs as being complete prior to October 1, 2013, if the building permit plans are consistent with the approved plans; or
- b. Filed on or after October 1, 2013, if the building permit plans are consistent with the filed plans, and some or all of the following apply:
 - 1. An unexpired approval of a first stage, second stage, or consolidated planned unit development, variance, special exception, design review under the Capitol Gateway (CG) or Southeast Federal Center (SEFC) overlay, or concept design by the Historic Preservation Review Board or Commission of Fine Arts; provided the vote to approve occurred prior to October 1, 2013;
 - 2. An unexpired approval of a variance, special exception, or design review under the CG or SEFC overlay granted on or after October 1, 2013, for which a public hearing was held prior thereto; or
 - 3. An unexpired approval of a first stage, second stage, or consolidated planned unit development that was granted after October 1, 2013, but which was set down for a public hearing prior thereto.

TRANSITION PERIOD MODIFICATIONS

Transition period exemptions are subject to removal if a change or modification is made to a permit, project, or application for exempted properties in 11 DCMR Subtitle C §601.3 or transition period exemptions in 11 DCMR Subtitle C §601.4 that results in an increase in impervious surface or lot occupancy of 20% or more (11 DCMR Subtitle C §601.5). In these cases, the full GAR requirement is applied to the portion of a project affected by the approved change or modification.

CAMPUS PLAN

A college or university applicant proposing a new building or addition to an existing building shall demonstrate the extent to which the building or addition meets the GAR standards. The Zoning Commission will determine if the proposal is compliant with the intent of the GAR regulations while processing approval for the construction under the campus plan.

ZONE DISTRICTS


A required level of GAR compliance is established by zones. Properties in zones listed in Table 1 are required to achieve the specified GAR. The required GAR standard is subject to change by the Zoning Commission and should always be confirmed by reviewing the zoning code regulations as posted on the DC Office of Zoning website. Information regarding converting the 1958 zone designations to the 2016 zone designations can be found on the DC Office of Zoning website: <https://dcoz.dc.gov/zrr/zone-conversion-table>.

Table 1 Green Area Ratio by Zone District

Zone District	Green Area Ratio
RA-1, RA-2, RA-6, RA-7, RA-8, RC-1, WR-2, WR-3, WR-4, WR-5, WR-7, WR-8	0.4
RA-3, RA-4, RA-5, RA-9, RA-10 MU-1, MU-2, MU-3, MU-4, MU-5, MU-6, MU-12, MU-13, MU-14, MU-15, MU-16, MU-17, MU-18, MU-19, MU-23, MU-24, MU-25, MU-26, MU-27 NC-1, NC-2, NC-3, NC-4, NC-5, NC-7, NC-9, NC-10, NC-11, NC-14, NC-16, NC-17 SEFC-2, SEFC-3, CG-1, CG-2, RC-2, RC-3, ARTS-1, ARTS-2, D-2, CG-5	0.3
MU-7, MU-8, MU-28, NC-6, NC-8, NC-12, NC-13, NC-15, ARTS-3, CG-5	0.25
MU-9, MU-10, MU-20, MU-21, MU-22, MU-29, SEFC-1, ARTS-4, CG-3, CG-4 D-3, D-4, D-5 D-1-R, D-4-R, D-5-R, D-6, D-6-R, D-7, D-8	0.2
PDR (all lots unless otherwise noted):	0.3
• Lot with principal building that is 1 story in height	0.1
• Lot with principal building that is 2 stories in height	0.2

Zone Definitions

Zone definitions can be referenced in the Zoning Regulation 11 DCMR Subtitle D–K (<http://www.dcregs.dc.gov/Search/DCMRSearchByTitle.aspx>).

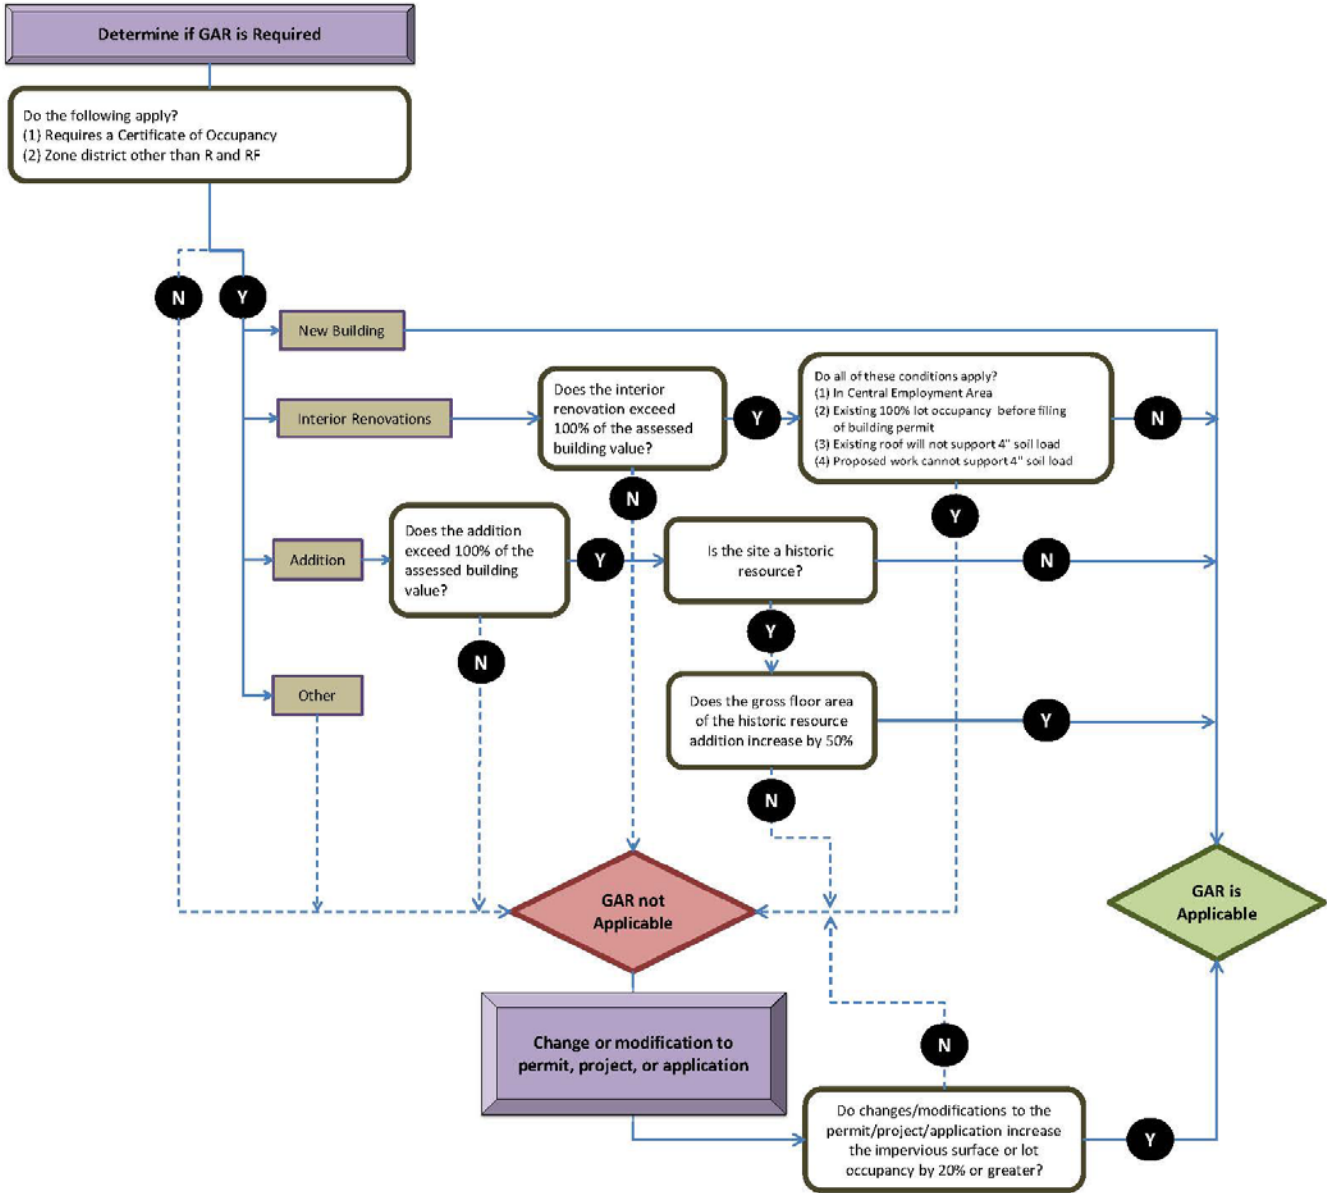

GAR Trigger Decision Tree

Chapter 3 Calculating the Green Area Ratio Score

DESIGN CONSIDERATIONS

Once you have determined the site’s zoning district and minimum required Green Area Ratio (GAR) score (see Table 1), you will need to design a plan of approved landscape elements that achieve that score. Table 2 indicates approved landscape elements and their multipliers.

Chapter 5 discusses each landscape element in detail. There are instructions for calculating square footages, which vary for each type of landscape element. The “Integration” sections include charts that show which landscape elements can be layered in the same area of the site to increase the total GAR score. The end of Chapter 3 provides more information about maximizing the GAR score.

In addition to the usual concerns for construction projects, it is also important to consider other regulations and standards that may impact GAR design, including the Department of Energy and Environment’s (DOEE’s) stormwater management regulation (21 DCMR Chapter 5) and soil erosion and sediment control regulation (21 DCMR Chapter 5), DOEE’s Stormwater Management Guidebook, the District Department of Transportation’s Green Infrastructure Standards, and the District of Columbia’s LEED certification criteria.

CALCULATING A PROJECT’S GAR SCORE

The following are the key steps to calculate a project’s GAR score:

1. Determine the total lot area.
2. Calculate the area of each proposed landscape element. For certain types of plantings, identify the number of individual plants.
3. Multiply the area of each landscape element by its assigned multiplier to provide a weighted square footage.
4. Add the weighted square footages of all landscape elements.
5. Divide the sum by the total lot area of the site to provide the project’s GAR score.
6. If needed, redesign the landscape elements to achieve the required GAR score. When applicable, ensure consistency with stormwater management plans.

GAR SCORESHEET

The GAR Scoresheet tool (see Appendix A) simplifies the process to calculate the project’s GAR score. The formulas and multipliers are built in. The user simply enters the total lot area, the

area of each landscape element (in square feet), and the numbers of individual plants (if applicable). The GAR Scoresheet is especially helpful for testing a variety of design options. The completed GAR Scoresheet must be submitted as part of the GAR plan.


The GAR Scoresheet is available online at <https://doee.dc.gov/GAR>.

Table 2 Landscape Element Multipliers

GAR Landscape Elements	Multiplier
Landscaped areas with a soil depth of less than 24 inches	0.3
Landscaped areas with a soil depth of 24 inches or more	0.6
Bioretention facilities	0.4
Ground covers, or other plants less than 2 feet tall at maturity	0.2
Plants at least 2 feet tall at maturity	0.3
Tree canopy for all trees with mature canopy spread of 40 feet or less calculated at 50 square feet per tree	0.5
Tree canopy for all new trees with mature canopy spread greater than 40 feet calculated at 250 square feet per tree	0.6
Tree canopy for preservation of existing trees 6 inches to 24 inches in diameter	0.7
Tree canopy for preservation of existing trees 24 inches diameter or larger	0.8
Vegetated walls, plantings on a vertical element	0.6
Extensive vegetated roof over at least 2 inches but less than 8 inches of growing media	0.6
Intensive vegetated roof over at least 8 inches of growing media	0.8
Permeable paving over at least 6 inches and less than 2 feet of soil or gravel	0.4
Permeable paving over at least 2 feet of soil or gravel	0.5
Enhanced tree growth systems	0.4
Renewable energy generation (area of)	0.5
Water features (using at least 50% recycled water)	0.2
Bonuses	
Native plant species listed in Subtitle C §603.9	0.1
Landscaping in food cultivation	0.1
Harvested stormwater irrigation	0.1

MAXIMIZING GAR SCORE

Nearly every landscape element within GAR is stackable. To demonstrate how elements may be stacked, consider the illustration below.

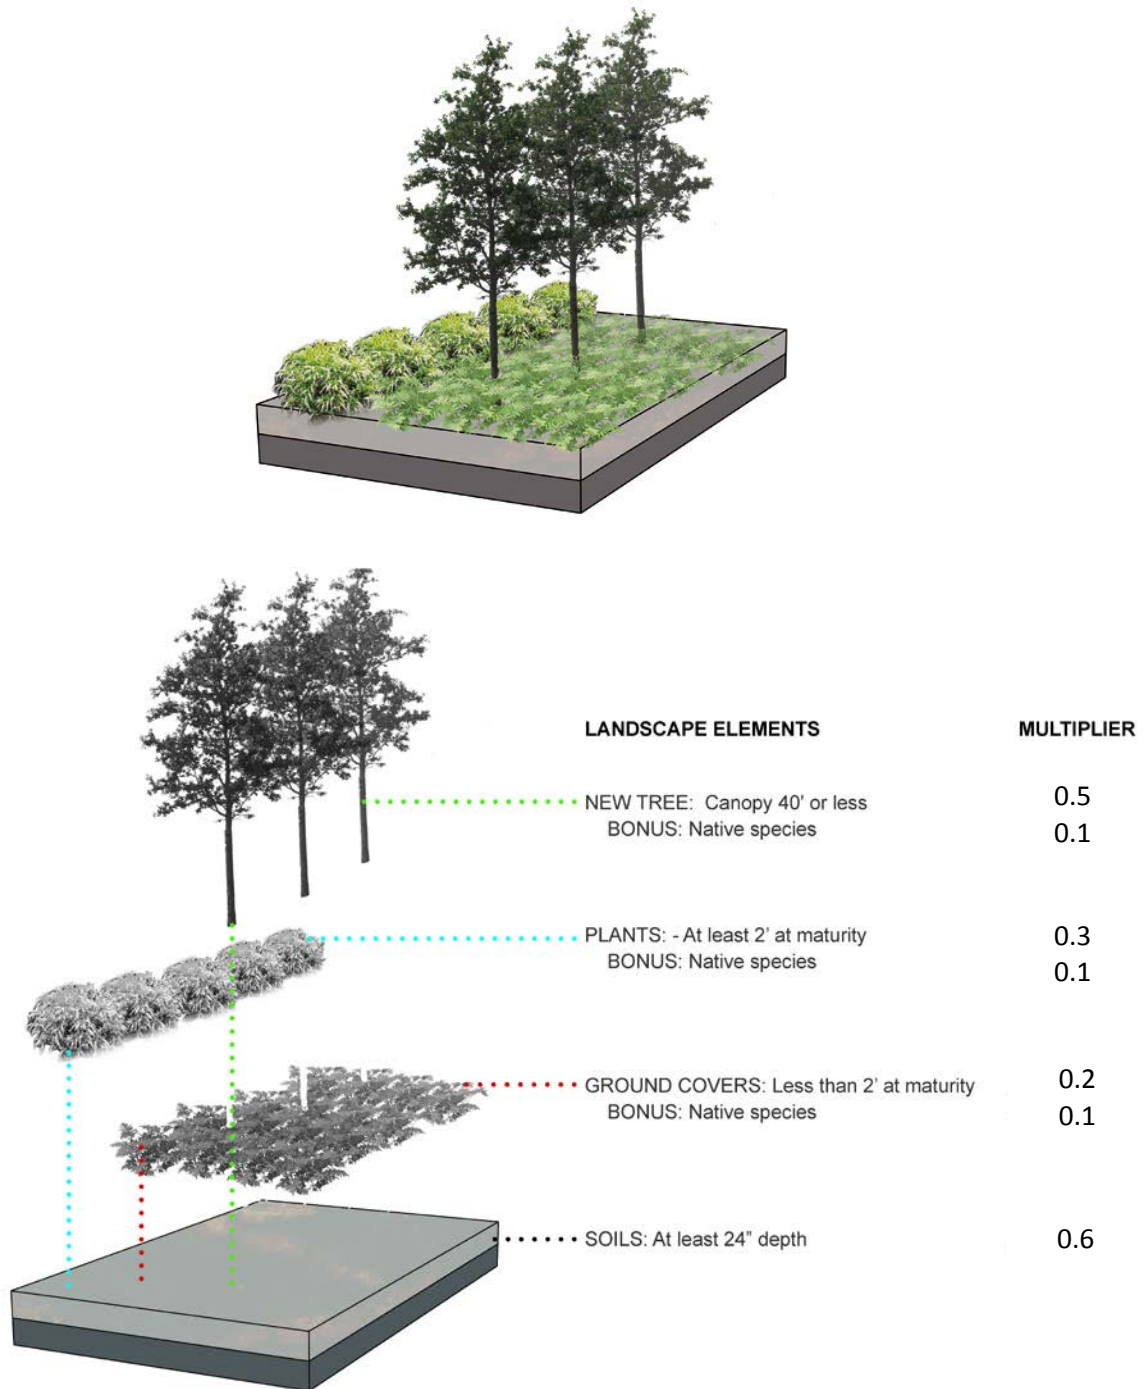

Assume that the landscaped area is 1,200 square feet. Because new trees are being planted the soils may seek the higher multiplier of 0.6 for soils greater than 24 inches (Section 5.1).

- 1,200 square feet (SOILS: At least 24" depth) x 0.6 = 720

On top of those soils is approximately 900 square feet of groundcover, which receives a multiplier of 0.2 (Section 5.3).

- 900 square feet (GROUND COVERS: Less than 2' at maturity) x 0.2 = 180

The designer lines one edge of the landscape area with five shrubs taller than two feet, which have an equivalent square footage (ESF) of nine square feet each and a multiplier of 0.3 (Section 5.3).

- 5 (PLANTS: At least 2' at maturity) x 9 (ESF) = 45 ESF x 0.3 = 13.5

The trees to be installed have a mature canopy less than 40 feet in diameter, granting them an ESF of 50 square feet per tree, and a combined multiplier of 0.5 (Section 5.3).

- 3 (NEW TREES: Canopy 40' or less) x 50 (ESF) = 150 ESF x 0.5 = 75

In addition to the normal credits, assume each plant is eligible for the DC area native bonus, so a multiplier of 0.1 may be used with the equivalent square footage of the combined vegetation (Section 5.11).

- Native Bonus: 900 (groundcover) + 45 (shrubs) + 150 (trees) = 1,095 ESF X 0.1 = 109.5

Combine each landscape element's weighted score plus the bonus to find the stacked score.

- Stacked Score: 720 + 180 + 13.5 + 75 + 109.5 = 1,098


The stacked score above is divided by the lot surface area to calculate the GAR score achieved.

- $1,098 \div \text{Lot Surface Area} = \underline{\text{GAR Score}}$

DETERMINE THE LOT AREA

What Qualifies as a Lot?

The lot area is determined by the official record lot. If the property is divided into tax lots, such as with phased development, the applicant must provide a plan showing how the overall, ultimately created record lot and each tax lot will comply with GAR.

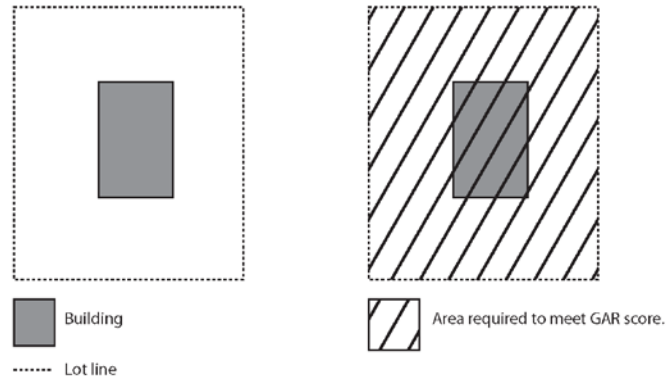

Multiple Lots and Phases

When multiple lots are developed within one permit application, each individual lot must meet the requirement for the zone. For phased construction and multiple lots submitted under a single plan, DOEE inspectors will not sign-off the Landscape Checklist until all credited elements are installed for each phase. In general, for multiple tax lots of an encompassing record lot, each tax lot should provide a GAR score, and the combined GAR score of all the tax lots should meet the record lot GAR score. Tax lot boundaries and scores will require approval by the Office of Zoning Administrator (OZA) and DOEE prior to building permit review.

Zone Boundary Line Crossing a Lot

Lots with more than one zone will require a determination by OZA. The lot area required for GAR compliance will equal the total area of lot that all applicable zone districts cover. The GAR score for this area, however, can be achieved anywhere within the lot.

Lots with Historic Structures

Lots with historic structures may be exempt from GAR, subject to the provisions of 11 DCMR C-601.7. However, if the gross floor area of a proposed addition to a historic structure exceeds 50% of the existing gross floor area, then GAR will be required and the lot area will exclude the footprint of the historic structure.


Chapter 4

Administration - Plan Development, Construction, and Maintenance

OVERVIEW

The Green Area Ratio (GAR) is a zoning regulation administered by the Department of Consumer and Regulatory Affairs (DCRA), Department of Energy and Environment (DOEE), and District of Columbia Office of Zoning. Plans are submitted to DCRA for zoning approval. When a site triggers GAR requirements, DOEE reviews and approves GAR plans as part of the building permit application. The applicant's Certified Landscape Expert (CLE) signs off on GAR plans and confirms appropriate installation or preservation of landscape elements during construction. After construction, the DOEE inspector and CLE jointly review the installation for conformance with the approved plans. After DOEE sign-off, the Zoning Administrator can then grant the Certificate of Occupancy.

Green Area Ratio Administrative Process

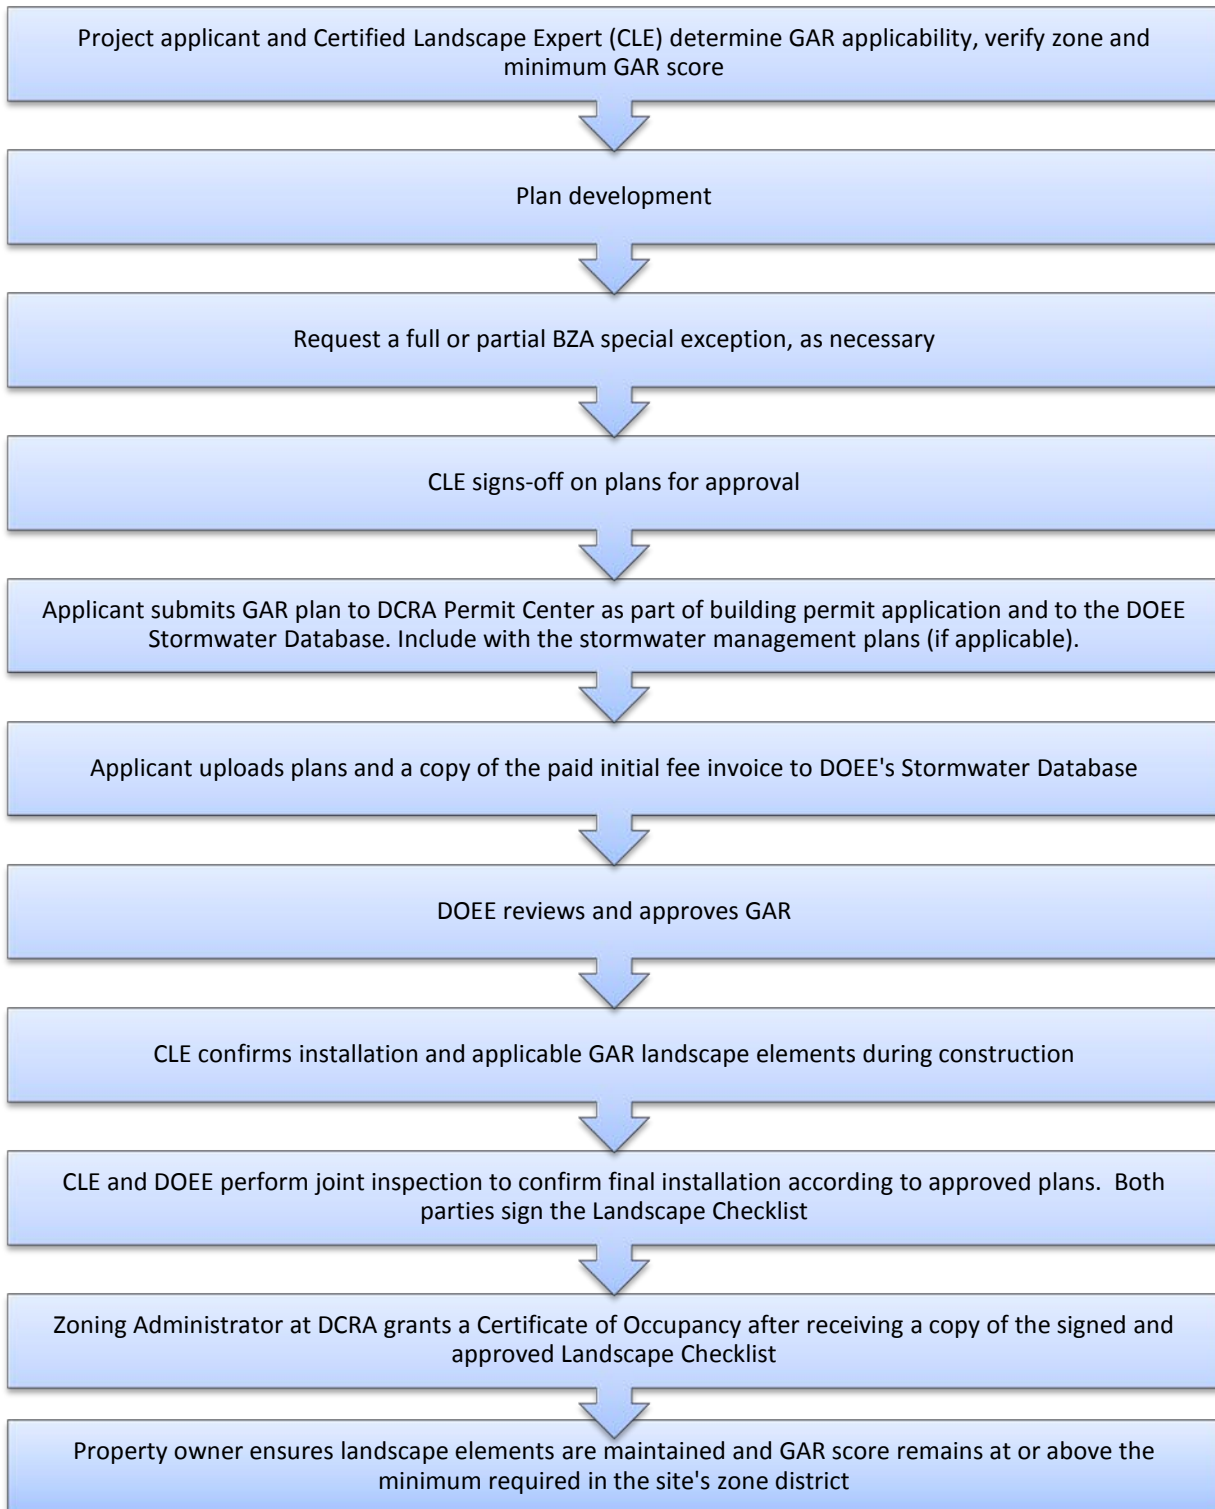

Certified Landscape Expert

The project applicant must secure a CLE to verify the plans and installation comply with GAR. The CLE who signs the GAR plans may be different from the CLE who signs the Landscape Checklist. The applicant should select a CLE who specializes in the type(s) of landscape elements used in the project.

The CLE is defined as any of the following:

- A Maryland or Virginia Licensed Landscape Architect;
- An International Society of Arboriculture (ISA) Certified Arborist;
- A Maryland Professional Horticulturist; or
- A Landscape Contractors Association, DC-MD-VA Landscape Industry Certified Technician.

The CLE must do the following:

- Sign off on submitted GAR plans to indicate they conform to the GAR regulations and GAR Guidebook;
- Confirm the landscape elements are installed according to the approved plan and then sign off on the Landscape Checklist; and
- Prepare and sign a landscape maintenance plan for the property owner.

PLAN SUBMITTAL AND REVIEW

Sites that Qualify for a Reduced GAR Score

The applicant may request a special exception from the Board of Zoning Adjustment (BZA) if the application meets sustainability goals through means outside the scope of GAR. The BZA may then choose to grant a full or partial reduction in GAR score requirements. If granted, the applicant will be issued a BZA Order stating the reduced GAR requirements. The BZA Order and a certified copy of the exhibits (plans submitted to the BZA for their review) must be provided with the building permit application.

Submittal Requirements

GAR plan review is part of the building permit application process managed by DCRA. Building permit applications may be submitted through the DCRA online intake form or in person at DCRA headquarters (1100 4th Street SW, 2nd Floor).

In the building permit application, if no stormwater review is required GAR plans are submitted through DCRA's ProjectDox system. If a stormwater review is required, GAR is reviewed in DOEE's stormwater database with the stormwater plans at the same time to avoid inconsistencies. All GAR plans must have the signature of the CLE to certify they meet or exceed the project's required minimum GAR score. Include 2 sets of signed GAR plans if submitting by paper. In addition to submitting the building permit application, the agent must also upload the

GAR plans and paid invoice and enter all required GAR site data into the DOEE Stormwater Database (<https://doee.dc.gov/swdb>).

GAR plan submittals must have the following elements to be considered for review and approval, dependent upon the landscape elements used. Additional requirements are described in each subsection.

General Requirements

- Blank space provided in the top left corner of the cover page, measuring 7 inches wide by 9.5 inches high and located 1 inch below the top edge and 1 inch from the left edge of the page
- Paid invoice for the initial fee uploaded in the DOEE Stormwater Database
- GAR Scoresheet within the plan drawings (see Appendix A)
- GAR Worksheet, if plans are more than one page (see Appendix A)
- GAR elements called out by category and area
- Lot dimension and size
- Graphic scale and dimensions (as needed)
- Location and area of all landscape elements
- Other drawings, including details, that enable interpretation of GAR plan documents
- Schematic irrigation and drainage plan for rooftop and container landscaping or areas requiring harvested rainwater irrigation
- Signed landscape maintenance plan within the submitted drawings or as separate document with notation in the plans that the landscape maintenance plan is a separate document within the submittal
- CLE's signature posted within the Landscape Expert Signature Template, printed name, name of certifying organization, and certification number.
- On the CLE signature page identify all sheet numbers included in the GAR submittal package.
- Plat or site-per-subdivision plan for proposed record lot, or otherwise identify tax lot boundary
- Construction specifications

Soils

- Soil depth and area, with dimensions specified on plan
- Soil and amendment specifications
- Soil protection measures if claiming credit

Bioretention

- Area of the filter bed
- Planting plan showing plant species, location, and size

New and Existing Plantings

- Location, spacing, installed size, and species of all plants used to meet GAR requirements
- Common and botanical names of all plant materials

Existing Trees

- Location, trunk diameter at breast height, estimated canopy radius, condition, and species of each preserved tree
- Tree preservation plans for the demolition and construction phases
- Location and dimensions of all measures used to protect landscape areas from vehicular traffic
- Location and size of all tree removals

Vegetated Walls

- Plant species, location, spacing, and size
- Detail and section showing area and type of support structure
- Setback dimensions from property line, as necessary

Vegetated Roofs

- Dimensions of growing media, showing area and depth
- Vegetated roof details and specs
- Plant species, size, spacing, type of root system, and location
- Rooftop access for maintenance

Permeable Paving

- Dimensions of pavement, showing area and depth
- Permeable pavement details and specs
- Infiltration tests and geotechnical reports

Enhanced Tree Soil Systems

- Plan and details, with associated dimensions and area
- Plan meets the design requirements outlined in the DOEE Stormwater Management Guidebook

Renewable Energy

- Reference electrical, plumbing, mechanical, and other relevant details and specs
- A copy of plan documents for project electrical, plumbing, and building permitting
- Site plan with drawings showing solar array, number of collectors or panels, system size, array dimensions, and location of array and mounting
- Schematic diagram showing balance of system components (system wiring, disconnects, inverter(s), valves, pipes, tanks and pumps)
- Shading analysis if more than 20% shading exists on the array location

Water Features

- Plans and details with associated dimensions
- Plumbing and drainage plan
- The landscape element must be covered with water a minimum of 6 months of the year and must use at least 50% harvested rainwater

Native Plants Bonus


- Calculations showing the species, quantity, and square footage for each native species being credited

Food Cultivation Bonus

- Location, species, and areas designated for food cultivation
- Identify building access
- Type and location of water source

Harvested Rainwater Irrigation Bonus

- Schematic irrigation and drainage plan showing areas, delivery system, anticipated water demand, and water budget indicating percentage of water demand met by rainwater calculated on a monthly and annual basis

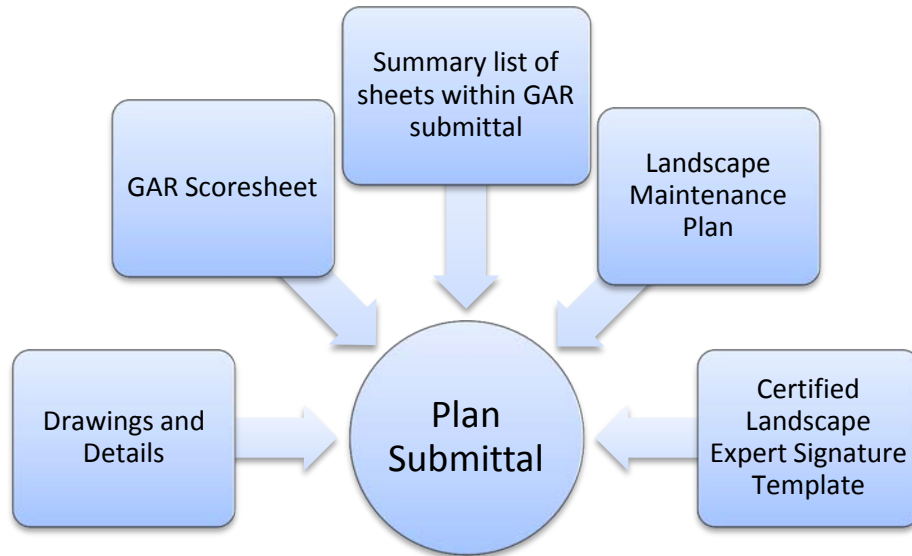

Plan Review

DOEE staff review GAR plans for compliance with the regulation and guidebook. Within 10 to 30 working days of the date DOEE receives the complete plan set and a copy of the paid initial GAR fee invoice, DOEE will review and make a determination to approve or disapprove the GAR plans. When a stormwater management plan is also required, the project engineers should coordinate to ensure the GAR plans are consistent with the stormwater management drawings. If the GAR plan is disapproved, DOEE will provide the reason for the denial in writing. When revisions are received, each subsequent review period will span 10 to 30 working days. Once GAR review is complete, a final submission package is required, including one PDF copy of the GAR plan set signed by the CLE and uploaded to the Stormwater Database. Instructions for electronic approval are available at <https://doee.dc.gov/swdb>, in the PDF "Instructions for Electronic Approval Stamps" under Attachment(s).

Revisions to Approved Plans

Substantial changes to an approved plan require supplemental review and reapproval by DOEE. Non-substantial changes do not require resubmission. Applicants should confirm with their reviewer that revisions do not require reapproval.

Substantial changes include any of the following:

- Reducing the number of plants within any credited category
- Changing the location of required plantings or landscape elements if this provides inadequate soil depth, soil volume, or cultural suitability
- Substituting species if any of the following apply:
 - New species are credited under another landscape element category (e.g., replacing plantings less than 2 feet tall with plantings at least 2 feet tall);

- Site conditions for new plantings do not meet the minimum requirements for those species, including soil depth or volume, irrigation requirements, or vegetated wall attachment type; or
- Replacing a native species with a non-native or otherwise crediting an invasive species
- Revising any features that could decrease the planting area or lower the GAR score per the requirements of the GAR regulation and guidebook

Non-substantial changes include any of the following:

- Increasing the number of trees, shrubs, or ground covers while maintaining minimum plant spacing and soil volumes listed in the GAR Plant List (available on DOEE's GAR webpage) and this guidebook
- Substituting species if all of the following apply:
 - New species are of the same landscape element category;
 - New plantings require equivalent soil depth and volume, vegetated roof drought tolerance, and vertical support appropriate to vegetated wall species; and
 - A non-native species is replaced with a native or other non-native/non-invasive plant
- Increasing the planting area while maintaining minimum plant spacing and coverage requirements

Fees

Prior to DOEE plan review, the applicant will pay an initial fee that includes an initial review, predesign meeting, and first resubmission. The applicant will pay a supplemental review fee for each review beyond the first resubmission. There is no charge to meet with DOEE for the initial hour; additional fees of \$72.26 per hour are assessed for time beyond the initial hour. Final fees are paid once DOEE approves the GAR plan and prior to the building permit being issued, as shown in Table 3 (also see 21 DCMR Chapter 5).

Table 3 Fees for Review of Green Area Ratio Plan (Source: 21 DCMR §501.10)

Payment Type	Payment Requirement	Fees by Combined Area of Land Disturbance and Substantial Improvement Building Footprint	
		≤ 10,000 ft ²	> 10,000 ft ²
Initial	Due upon filing for building permit	\$593.55	\$877.43
Final	Due before building permit is issued	\$129.03	\$206.45
Supplemental	For reviews after first resubmission	\$516.13	

DOEE shall adjust the fees annually for inflation. Fees listed in Table 3 are current as of April 21, 2017. Please check 21 DCMR Chapter 5 for current fees.

CONSTRUCTION INSPECTION

The CLE must confirm that all GAR landscape elements are properly installed according to the approved GAR plan. Once the landscape elements are installed and fully established, the applicant must contact the DOEE Inspection and Enforcement Division, Construction and Maintenance Branch to schedule an inspection.

To schedule a GAR final inspection, visit DOEE's Construction Site Inspections website at <https://doee.dc.gov/service/construction-site-inspections>. Please provide the inspector at least 48 hours advanced notice before the anticipated inspection date.

During the inspection, the CLE and DOEE inspector review the plans and site for compliance, and both parties sign the Landscape Checklist (see Appendix A) upon confirming that the site is built according to the approved building permit. Chapter 5 describes the CLE's responsibilities for each landscape element.

Certificate of Occupancy

The Office of Zoning Administrator relies upon DOEE to confirm sites have met their GAR requirements. Before approving a Certificate of Occupancy application, the Zoning Administrator must receive the signed and approved Landscape Checklist from the applicant.

Temporary Certificate of Occupancy

The applicant may request a temporary Certificate of Occupancy from the Zoning Administrator if installation of landscape elements is prevented due to the following:

- Weather
- Season
- Site construction

The temporary Certificate of Occupancy is valid for 4 months and is granted by the Office of Zoning Administrator based on the recommendations of DOEE inspectors, with the condition that the landscaping be installed before the temporary certificate expires. The temporary Certificate of Occupancy may be granted only twice, each for a 4-month period, based on the conditions of 11 DCMR Subtitle C §604.9.

MAINTENANCE OBLIGATION

A property owner is required to maintain the GAR score through appropriate stewardship and maintenance of landscape elements after the property is granted its Certificate of Occupancy. When the GAR score falls below the minimum required, a property owner may choose to meet that requirement with an equivalent but different landscape element of their choosing. After

the Certificate of Occupancy has been granted by the Office of Zoning Administrator, property owners are not required to resubmit GAR plans to DCRA for reapproval.

Prior to signing the Landscape Checklist, the CLE provides the landscape maintenance plan to the property owner. The landscape maintenance plan serves as guidance toward continued upkeep of the approved landscape elements. Regardless of subsequent property ownership and possession of the landscape maintenance plan, owners and their designated agents are required to ensure that GAR landscape elements are properly maintained and the minimum GAR score is upheld. See Chapter 6, Landscape Maintenance Plan for additional guidance.

Note: Properties in the Anacostia Watershed Development Zone with a stormwater management obligation must also prepare an Integrated Pest Management Plan (see the DOEE Stormwater Management Guidebook, Appendix R) as part of their GAR maintenance plan.

Chapter 5 Landscape Elements


OVERVIEW

This chapter describes the 13 approved categories of Green Area Ratio (GAR) landscape elements: soils and amendments, bioretention, new and existing plantings, tree preservation, vegetated walls, vegetated roofs, permeable paving, enhanced tree soil systems, renewable energy, water features, native plants, food cultivation, and harvested stormwater irrigation. Several categories include multiple options. Each sub-chapter provides a table showing other credits and bonuses which may be stacked with the described landscape element, as demonstrated below.

Landscape elements that can be credited over the same surface area	Soils & Amendments	Bioretention	New & Existing Planting	Tree Preservation	Vegetated Walls	Vegetated Roofs	Permeable Paving	Enhanced Tree Growth	Renewable Energy	Water Features	Native Plants	Food Cultivation	Harvested Stormwater Irrigation
New & Existing Planting													

The gray square is the credit being pursued. The green and orange highlighted squares are landscape elements which may also be credited within the same area as the gray credit by way of the stacked system described in Chapter 3. Green indicates credits. Orange indicates bonus elements with credit prerequisites (further defined in each bonus section). There may be some variation in the stackable elements depending on the project.

Each section then describes how the landscape element may be used to meet GAR requirements through Integration, Submittal Requirements, and design and construction Standards, as outlined below:

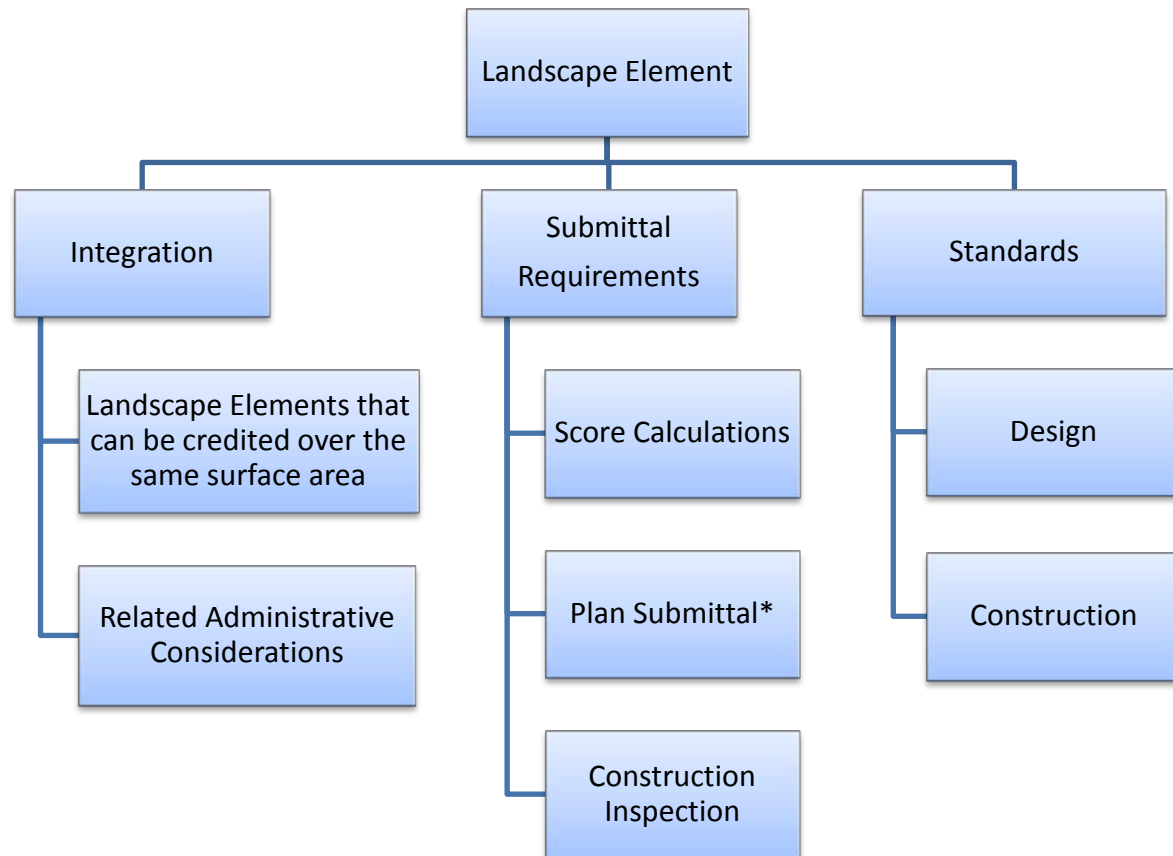

* Refer to the "Submittal Requirements" section in Chapter 4

Integration – Defines how each landscape element may be stacked in order to meet the minimum GAR score and lists relevant regulations and guides.

Submittal Requirements – Outlines the materials to be submitted and signed by the Certified Landscape Expert (CLE), which are further defined under Standards. By submitting and signing the GAR plans and calculations, the CLE certifies that the proposed elements will meet the minimum design standards. By signing the GAR Checklist, the CLE confirms that they have inspected the landscape elements before, during, and after construction, and the installed elements meet the minimum construction standards.

Standards – Details the minimum design and construction requirements which each landscape element must meet. In addition to meeting GAR requirements, all landscape elements must comply with DOEE, DCRA, Pepco, and DC Water building requirements.

BENEFITS OF LANDSCAPE ELEMENTS

GAR is intended to increase the use of landscaping and sustainable infrastructure practices within the District of Columbia. These types of practices yield many environmental, aesthetic, and public health benefits:

- Stormwater management and retention
- Nutrient cycling
- Carbon sequestration
- Erosion control
- Heat island reduction
- Evaporative cooling
- Improved building energy efficiency
- Improved air quality
- Noise reduction
- Urban agriculture
- Habitat creation and increased biodiversity
- Pollutant sequestration
- Mental well-being
- Increased opportunities for physical activities
- Improved public awareness of locally grown produce and healthy living

5.1 Soils and Amendments

Landscaped areas with topsoil receive points toward a site's total GAR score. To be eligible, existing topsoil must be protected during construction or amended with compost if it has been disturbed. Imported topsoil also qualifies if it meets standards indicating that it is capable of supporting plant growth.

INTEGRATION

Landscape elements that can be credited over the same surface area	Soils & Amendments	Bioretention	New & Existing Planting	Tree Preservation	Vegetated Walls	Vegetated Roofs	Permeable Paving	Enhanced Tree Growth	Renewable Energy	Water Features	Native Plants	Food Cultivation	Harvested Stormwater Irrigation
Soils & Amendments													

RELATED ADMINISTRATIVE CONSIDERATIONS

DOEE Erosion and Sediment Control Manual.

SUBMITTAL REQUIREMENTS

CALCULATING THE SCORE

Measure the surface area and depth of uncompacted topsoil. Soil depth determines the GAR multiplier as noted in the following chart.

GAR Landscape Elements	Multiplier
Landscaped areas with a soil depth of less than 24 inches	0.3
Landscaped areas with a soil depth of 24 inches or more	0.6

Soils for new trees, existing trees, and vegetated walls must be installed, and shall be credited, at a depth greater than 24 inches to the maximum allowable volume. Soils for all other plantings shall be credited at a depth less than 24 inches.

PLAN SUBMITTAL

In addition to complying with the standards described below, submitted GAR plans shall include the following:

- Soil depth and area, with dimensions specified on plan
- Soil protection measures specified on the plan for existing soils if claiming credit
- Location and species of existing vegetation on preserved soils

- Soil improvement specification for amending and installing existing disturbed soils or imported topsoil. Specifications should include the following parameters:
 - Texture class and particle size (for imported topsoil only)
 - Percentage organic matter
 - pH
 - Installation guidelines, including subgrade preparation, soil handling and storage, and installation procedures
 - Amendment incorporation method and rate for compost, limestone, or acidulants

CONSTRUCTION INSPECTION

The Certified Landscape Expert (CLE) is responsible for confirming the following construction items meet the standards below prior to signing the Landscape Checklist:

- Area and depth of topsoil are installed per plan, with soils decompacted to depth
- Topsoil conforms to soil improvement specifications
- Subgrade is scarified and decompacted
- Debris and contaminants are removed prior to installation of topsoil
- Topsoil is permanently stabilized with vegetative cover or mulch

STANDARDS

These are the standards to be followed in GAR plans. Some specifications may be modified based on site conditions and the requirements of each landscape type if the applicant provides appropriate justification. Specifications administered by other agencies may be substituted as authorized by DOEE.

Bioretention facilities, vegetated roofs, and enhanced tree growth systems typically require soil media with specifications designed with special consideration for infiltration, weight, or load-bearing capacity.

In the design phase, send samples of existing soil to a reputable agronomic soil testing laboratory to test a full range of soil quality parameters. For imported topsoil, perform testing prior to delivery and again prior to planting.

The soil improvement specification shall identify soil texture, organic matter percentage (by weight), pH, and soil installation or amendment incorporation practices. It applies to both existing and imported soil. Existing topsoil must have healthy vegetated cover, be protected during construction, and remain uncompacted. Soils marked for preservation that have been disturbed must be amended with compost to receive credit. Imported topsoil must meet minimum standards identified in the specifications.

Coordinate soil plans with the erosion and sediment control regulations (21 DCMR Chapter 5) and, where applicable, the DOEE Stormwater Management Guidebook, Appendix N Land Cover Designations and Appendix J Soil Compost Amendment Requirements.

The following are design guidelines for protecting, amending, or importing topsoil.

Protecting Existing Topsoil Throughout Construction

Specify fencing or other measures to protect topsoil from compaction, construction debris, and contamination during the construction process. Protected topsoil must have existing healthy vegetation and remain uncompacted. These soils are credited with a soil depth of greater than 24 inches.

Amending Existing Disturbed Topsoil

Unless the existing disturbed soils meet the minimum organic matter content, as determined by a soil test, imported and amended topsoil must meet the following requirements. If protected topsoil becomes disturbed or the vegetation is removed, it must be amended with compost, meet the guidelines described below, and will receive credit based on the new plants installed.

Existing topsoil that is disturbed may be stripped, stored, and spread to avoid compaction and contamination. Stockpiled topsoil must be amended with compost when respread. A soil scientist can identify the deficiency of organic matter in existing soil and specify the required rate to meet the specific landscape use (e.g., lawn areas, planting beds). This approach is especially useful for larger sites. Where soil has been disturbed, provide a minimum of 5% organic matter by weight to a 12-inch or greater soil depth. See the recommended specifications below for a default compost application rate.

Importing New Topsoil

Topsoil recommendations are listed below. Alternative specifications, such as the District Department of Transportation's Green Infrastructure Standards, may be substituted with permission from DOEE. Topsoil for stormwater best management practices shall comply with the DOEE Stormwater Management Guidebook.

Soil Depth and Volume

Soil depth is measured by the depth of non-compacted topsoil. Topsoil shall be placed over material of suitable drainage that is clear of contaminants and debris. Minimum topsoil depth varies by plant type:

- Turf grass, at least 6 inches and less than 12 inches
- Perennials, ground cover, and ornamental grasses, at least 12 inches and less than 18 inches
- Shrubs, at least 18 inches and less than 24 inches
- Trees, at least 24 inches; maximum credited depth is 36 inches

Soil volume for trees shall meet the following minimum standards:

- Soil volumes may be credited at a maximum 3-foot depth
- New trees with mature canopy of 40-foot spread or greater (see the GAR Plant List for guidance) – 1,000 cubic feet (minimum) to 1,500 cubic feet (maximum) accessible within a 27-foot radius
- New trees with mature canopy under 40-foot spread (see the GAR Plant List for guidance) – 400 cubic feet (minimum) to 600 cubic feet (maximum) accessible within a 16-foot radius
- To credit trees that do not meet the minimum soil volume guidelines, refer to Section 5.3, New and Existing Plantings, “Calculating the Score”
- Existing preserved trees do not require a minimum soil volume but may be credited at greater than 24-inch depth up the limits of the critical root zone per the guidelines listed in Section 5.4 Tree Preservation
- Vegetated walls require a minimum 1 cubic foot of soil for every 10 square feet of credited growth, assuming a maximum 3-foot soil depth

SOIL IMPROVEMENT SPECIFICATION (TOPSOIL DESIGN)

Table 5 Topsoil Physical and Chemical Parameters

Topsoil characteristic	Test Method	Required Standard
Texture class		Loam, silt loam, sandy clay loam, sandy loam, clay loam
% Sand (0.05 mm–2.00 mm)	Hydrometer	< 70%
% Silt (0.002 mm–0.05 mm)	Hydrometer	< 70%
% Clay (< 0.002 mm)	Hydrometer	< 30%
% Organic matter (by weight)	Loss of Ignition	Lawn areas (4%–6%) Planting beds (5%–7%)
pH		6.0–7.2, specific plantings may require alternate values
Macronutrients & micronutrients		Determined by professional soil scientist

Soil Source

The topsoil and subgrade may be from a naturally occurring soil or soil that has been mixed to achieve the requirements of the plant selections.

Debris Content

Particles and stone greater than 1 inch in the longest dimension should not be allowed. This includes fragments of brick, concrete, wood, glass, metal, stone, and plastic. The total volume less than 1 inch long should not be more than 5% of the soil volume. Stones ranging from 0.5 to


1 inch (1.25 to 2.5 centimeters) should not exceed 5% of the soil volume, and gravel 0.25 to 0.5 inches (0.6 to 1.25 centimeters) should not exceed 5% of the soil volume.

Contaminants Prohibited

The soil shall have no herbicides, heavy metals, biological toxins, or hydrocarbons that will impact plant growth.

Texture

Topsoil texture can be variable and include loam, silt loam, sandy clay loam, sandy loam, and clay loam. The percent composition must fall within this range: sand < 70 %, silt < 70%, and clay < 30%. Particle size is determined according to U.S. Department of Agriculture Classification: clay < 0.002 millimeters (mm), silt 0.002 mm–0.05 mm, and sand 0.05 mm–2 mm.

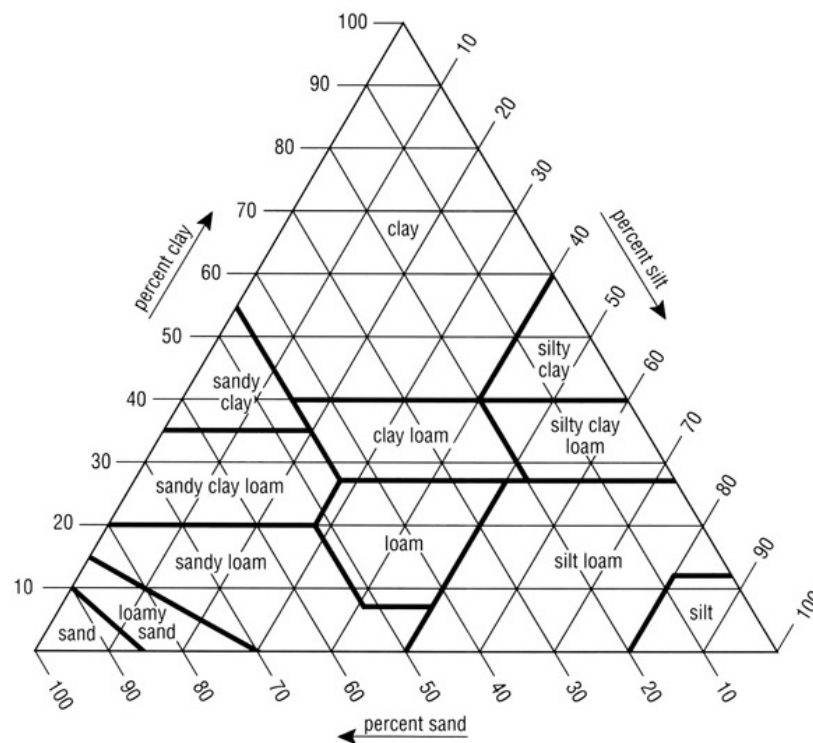

Soil texture triangle (source: USDA NRCS)

Organic Matter

Organic matter should be a minimum of 4% in lawn soils and 5% in planting beds. Percentage organic matter is measured by weight. Incorporate compost to raise organic matter content.

Soil pH

Soil pH determines the availability of nutrients in the soil. The exact pH range is dependent on the plant species and should be tested and adjusted based on species prior to installation. The ideal pH for most landscape plants falls in the range of 6.0–7.0; however, other plants prefer a

pH outside this range. A pH of 6.5–7.2 is beneficial to microbial activity that converts nitrogen, phosphorous, and sulfur into forms most available to plants.

Nutrient Recommendations

Have a soil scientist provide recommendations for macronutrients and micronutrients.

TOPSOIL CONSTRUCTION

Soil Density and Compaction

Soil density must be high enough to avoid settlement and low enough to encourage root growth. Using a rod penetrometer, soil and subsoil shall be less than 260 pounds per square inch (psi) throughout the depth of credited soil. Compaction completely inhibits root growth at 300 psi. A rod cone penetrometer should be used to measure compaction when soil moisture is at field capacity, after the soil is wetted but drained. The penetrometer shall be inserted at a rate of 72 inches per minute (1.2 inches per second), according to American Society of Agricultural Engineers Soil Testing Specifications.

Excavate test pits to indicate amendment incorporation. A rod penetrometer should be used to establish the depth of uncompacted soil (< 260 pounds per square inch) at a minimum of one location per 10,000 square feet.



Soil depth (source: Univ. of Mich.)



Soil penetrometer (source: Cornell University)

Subgrade Preparation

Using a backhoe or similar device, scarify and loosen the subgrade. Remove from the area all debris or stones that are 1 inch or greater.

Percolation

After preparing the subgrade, conduct a percolation test. Water should drain readily from the soil. Percolation rates of 1–2 inches per hour are preferred if irrigation will be installed. A

drainage system should be installed if the native subsoil has a drainage rate less than 1 inch per hour.

Handling, Storage, and Spreading Topsoil

Material shall not be handled or hauled when it is wet, as after a heavy rainfall, or if frozen. Soil shall be handled only when the moisture content is less than at field capacity. The CLE or a professional soil scientist shall be consulted to determine if the soil is too wet to handle. Stockpiles shall be covered during wet weather.

Spread topsoil in no greater than 12-inch lifts, using the lightest possible equipment. Compact the topsoil to the proper soil density so that it is suitable for root growth and plant stability.

SOIL IMPROVEMENT SPECIFICATION (AMENDMENT DESIGN)**Compost**

Compost shall be derived from plant material and provided by a member of the U.S. Composting Seal of Testing Assurance program. See www.compostingcouncil.org for a list of local providers.

Alternative specifications and/or certifications, such as those administered by the Maryland Department of Agriculture or other agencies, may be substituted, as authorized by DOEE. In all cases, compost material must meet standards for chemical contamination and pathogen limits pertaining to source materials, as well as reasonable limits on phosphorus and nitrogen content to avoid excessive leaching of nutrients.

The compost shall be the result of the biological degradation and transformation of plant-derived materials under conditions that promote anaerobic decomposition. The material shall be well composted, free of viable weed seeds, and stable with regard to oxygen consumption and carbon dioxide generation. The compost shall have a moisture content that has no visible free water or dust produced when handling the material. It shall meet the following criteria, as reported by the U.S. Composting Council Seal of Testing Assurance Compost Technical Data Sheet provided by the vendor:

- a. 100% of the material must pass through a 1/2-inch screen
- b. The pH of the material shall be between 6 and 8
- c. Manufactured inert material (plastic, concrete, ceramics, metal, etc.) shall be less than 1.0% by weight
- d. The organic matter content shall be between 35% and 65%
- e. Soluble salt content shall be less than 6.0 millimhos per centimeter (mmhos/cm)
- f. Maturity must be greater than 80%
- g. Stability shall be 7 or less
- h. Carbon/nitrogen ratio shall be less than 25:1

- i. Trace metal test result = “pass”
- j. The compost must have a dry bulk density ranging from 40 to 50 pounds per cubic foot

Additional Amendments

Limestone – dolomitic limestone containing no less than 50% total carbonates and 25% total magnesium with a neutralizing value of at least 100%.

Acidulant – commercial grade sulfur, ferrous sulfate, and aluminum sulfate for horticultural use.

Fertilizer – granular or pelleted slow-release fertilizer consisting of 50% water-insoluble nitrogen, phosphorous, and potassium in a composition recommended by the soil testing laboratory.

AMENDMENT CONSTRUCTION

Compost Application Rate

To achieve a minimum 5% organic matter content, apply compost at the rate specified below.

Add 1.75 inches of compost per 8 inches of existing topsoil and incorporate by rototilling or mixing prior to resspreading stockpiled topsoil. Scarify the subgrade down to a 4-inch depth. Using 35%–60% organic matter in compost will provide a topsoil organic matter rate of 5%. The amended soil and subsoil together provide 12 inches of amended topsoil. For deeper soils, such as planting beds, mix compost and topsoil at the same rate.

The DOEE Stormwater Management Guidebook, Appendix J, describes compost application rates for impervious cover disconnections and grass swales.

REFERENCES

Design Trust for Public Space, New York City Department of Parks & Recreation. 2010. “Best Practices in Site Systems: Soils.” In *High Performance Landscape Guidelines*. Design Trust for Public Space and NYCDPR, pp. 122–159.

District of Columbia Department of Transportation. 2014. *Green Infrastructure Standards*. <http://ddot.dc.gov/GreenInfrastructure>.

Duiker, Sjoerd W. 2002. “Diagnosing Soil Compaction Using a Penetrometer (Soil Compaction Tester).” In *Agronomy Facts 63*. The Pennsylvania State University. <http://extension.psu.edu/plants/crops/soil-management/soil-compaction/diagnosing-soil-compaction-using-a-penetrometer>.

Hanks, Dallas and Ann Lewandowski. December 2003. *Protecting Urban Soil Quality: Examples for Landscape Codes and Specifications*. United States. Department of Agriculture. Natural

Resources Conservation Service.

https://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs143_019258.pdf.

Penn State Cooperative Extension. "Using Compost to Improve Turf Performance."

<http://plantscience.psu.edu/reduce-runoff/best-management-practices/using-composts-to-improve-turf-performance>.

Smiley, Dr. E. Thomas. *Bartlett Tree Research Laboratories Technical Report: Soil for Urban Tree Planting*. <http://www.bartlett.com/resources/SoilforUrbanTreePlanting.pdf>.

Urban, James. 2008. *Up By Roots: Healthy Soils and Trees in the Built Environment*. International Society for Arboriculture.

Washington State Department of Ecology. 2016. "Building Soil: Guidelines and Resources for Implementing Soil Quality and Depth BMP T5.13." In *WDOE Stormwater Management Manual for Western Washington*. http://buildingsoil.org/tools/Soil_BMP_Manual.pdf.

RESOURCES

University of Maryland Cooperative Extension. "Implementing Best Management Practices (BMPs) to Reduce Runoff and Lawn Fertilizer Use."

<https://extension.umd.edu/hgic/soils/selecting-and-using-soil-testing-laboratory-hg-110>.

5.2 Bioretention

Bioretention facilities are practices that capture and store stormwater runoff and pass it through a filter bed of engineered soil composed of sand, soil, and organic matter. Filtered runoff may be returned to a storm sewer or allowed to infiltrate into the soil.

INTEGRATION

Landscape elements that can be credited over the same surface area	Soils & Amendments	Bioretention	New & Existing Planting	Tree Preservation	Vegetated Walls	Vegetated Roofs	Permeable Paving	Enhanced Tree Growth	Renewable Energy	Water Features	Native Plants	Food Cultivation	Harvested Stormwater Irrigation
Bioretention													

RELATED ADMINISTRATIVE CONSIDERATIONS

DOEE Stormwater Management Guidebook, Section 3.6 Bioretention and Section 3.9 Open Channel Systems.

SUBMITTAL REQUIREMENTS

CALCULATING THE SCORE

Square footage is determined by measuring the extents of the bioretention filter bed. Do not include side slopes in area calculation.

GAR Landscape Elements	Multiplier
Bioretention facilities	0.4

PLAN SUBMITTAL

In addition to complying with the standards described below, submitted GAR plans shall show the dimensions and area of the bioretention filter bed and include a planting plan showing plant species, location, and size. All plans incorporating stormwater management elements must meet DOEE stormwater management guidelines. If a stormwater management plan is required, coordinate with the project engineers to ensure that all stormwater management practices within the property are consistent on all submitted documents.

CONSTRUCTION INSPECTION

The Certified Landscape Expert (CLE) is responsible for confirming the following construction items meet the standards below prior to signing the Landscape Checklist:

- Confirm horticultural suitability of soil prior to planting

- Inspect plantings for quality control
- Ensure installation per plan and adjust as site conditions require
- Maintain plantings during the establishment phase
- Confirm area of installed bioretention zone

STANDARDS

Before designing a bioretention system, address the following feasibility, pretreatment, and design standards developed by DOEE and DC Water:

- DOEE Stormwater Management Guidebook, Section 3.6 Bioretention and Section 3.9 Open Channel Systems
- DC Water Green Infrastructure Utility Protection Guidelines:
<https://www.dwater.com/sites/default/files/Green%20Infrastructure%20Utility%20Protection%20Guidelines.pdf>

DESIGN

Several bioretention design variants are acceptable under GAR, as defined in the DOEE Stormwater Guidebook, including the following:

- Traditional bioretention
- Stormwater planters
- Residential rain gardens

Open Channel Systems, as defined in the DOEE Stormwater Guidebook, may also receive bioretention credit for GAR. Design variants include the following:

- Dry swales/bioswales
- Grass channels
- Wet swales

Bioretention facilities shall be landscaped areas that receive rainwater from surrounding areas and use plants and soils to slow, filter, and infiltrate stormwater runoff. Structures made of concrete alone, such as concrete runoff channels, are not credited for bioretention.

Bioretention systems shall be planted primarily with native herbaceous and woody species that are suitable for bioretention, as described in the DOEE Stormwater Management Guidebook; however ornamental species are acceptable as long as they are not aggressive or invasive. The GAR Plant List and Section 3.6 of the DOEE Stormwater Management Guidebook recommend acceptable native species. Criteria are also discussed in this guidebook in Section 5.11 Native Plants.

Bioretention soil must be compatible with the bioretention soil specifications listed in the DOEE Stormwater Management Guidebook.

All bioretention and open channel systems must follow the minimum feasibility, pretreatment, and design criteria described in the DOEE Stormwater Management Guidebook, Section 3.6 Bioretention and Section 3.9 Open Channel Systems. Stormwater runoff and retention calculations are not required.



Top Left: Small residential rain garden installed as part of the DOEE RiverSmart Homes program. Top Right: Example of traditional bioretention along Oxon Run in SE DC. Bottom Left: Stormwater planter installed as part of the DOEE RiverSmart Communities program at Galen Terrace in SE DC. Bottom Right: Dry Swale (source: Chesapeake Stormwater Network)

In association with other required professionals, the CLE will review horticultural suitability of soil and plant material during the design and construction phases

Planting recommendations for bioretention facilities are as follows:

- The primary objective of the planting plan is to cover as much of the surface areas of the filter bed as quickly as possible. Herbaceous or ground cover layers are as or more important than more widely spaced trees and shrubs.

- Native plant species should be specified over non-native species.
- Diverse pollinator and wildlife habitat plant species are encouraged.
- Plants should be selected based on a specified zone of hydric tolerance and must be capable of surviving both wet and dry conditions (“wet footed” species should be planted near the center, whereas upland species do better planted near the edge).
- Woody vegetation should not be located at points of inflow.
- Trees should not be planted directly above underdrains but should be located closer to the perimeter.
- Shrubs and herbaceous vegetation should generally be planted in clusters and at higher densities (i.e., 5 feet on center and 1–1.5 feet on center, respectively).
- Tree spacing shall be specified to comply with the minimum tree soil volumes specified in this guidebook.
- Planting holes for trees must be at least 3 feet deep to provide enough soil volume for the root structure of mature trees. This requirement applies even if the remaining soil layer is shallower than 3 feet.
- Tree species should be those that are known to survive well in the compacted soils and the polluted air and water of an urban landscape.
- If trees are used, plant shade-tolerant ground covers within the dripline.
- If the bioretention area is to be used for snow storage or is to accept snowmelt runoff, it should be planted with salt-tolerant, herbaceous perennials.

CONSTRUCTION

The contractor is required to ensure that proposed bioretention areas are protected from soil disturbance prior to and throughout the construction process to preserve soil infiltration rates. Stabilize surrounding areas prior to beginning bioretention construction.

After the contractor installs all required engineered layers and filter media, the contractor can then install plantings, apply mulch or jute/coir matting, and finally open the bioretention facility to stormwater inflow after plantings have established.

When constructing a bioretention system, consult the DOEE Stormwater Management Guidebook, Sections 3.6.6 and 3.9.6. Include bioretention construction and protection notes in the GAR plan.

REFERENCES

District of Columbia. Department of Energy and Environment. 2013. “Bioretention.” In *DOEE Stormwater Management Guidebook*. 99-128. Washington, DC.

District of Columbia. Department of Energy and Environment. 2013. "Appendix O Initial Feasibility Assessment." In *DOEE Stormwater Management Guidebook*. O-1 – O-2. Washington, DC.

5.3 New and Existing Plantings

Large plants provide greater environmental benefit than small plants. The combination of multilayered plantings (e.g., canopy trees, understory, ground cover, perennial plantings, and turf grass) enables a site to achieve a higher GAR score than would otherwise be possible.

INTEGRATION

Landscape elements that can be credited over the same surface area	Soils & Amendments	Bioretention	New & Existing Planting	Tree Preservation	Vegetated Walls	Vegetated Roofs	Permeable Paving	Enhanced Tree Growth	Renewable Energy	Water Features	Native Plants	Food Cultivation	Harvested Stormwater Irrigation
New & Existing Planting													

RELATED ADMINISTRATIVE CONSIDERATIONS

DOEE Stormwater Management Guidebook, Section 3.14.1 Tree Planting and Preservation.

SUBMITTAL REQUIREMENTS

SCORE DETERMINATION

The New and Existing Planting landscape element is divided into 7 categories, each with a defined square footage. For plants less than 2 feet tall at maturity, square footage is measured as the expected coverage at maturity. DOEE has provided a GAR Plant List to assist with plant selection; however applicants may select other vegetation as long as it is not listed as an invasive species in the District. See Section 5.11 Native Plants for invasive species references.

GAR Landscape Elements	Equivalent Square Footage (ft ² per plant/tree)
Ground covers, or other plants less than 2 feet tall at maturity	Square footage at maturity
Plants at least 2 feet tall at maturity	9
Tree canopy for new trees with less than 40-foot canopy spread	50
Tree canopy for new trees with 40-foot or greater canopy spread and preserved trees 6–12 inches in diameter	250
Tree canopy for preserved trees 12–18 inches in diameter	600
Tree canopy for preserved trees 18–24 inches in diameter	1,300
Tree canopy for preserved trees larger than 24 inches in diameter	2,000

The categories are also assigned a multiplier, increasing with size and associated environmental benefit.

GAR Landscape Elements	Multiplier
Ground covers, or other plants less than 2 feet tall at maturity	0.2
Plants at least 2 feet tall at maturity	0.3
Tree canopy for all new trees with mature canopy spread of 40 feet or less	0.5
Tree canopy for new trees with mature canopy spread of greater than 40 feet	0.6

Standards of Measurement

- Refer to the American Horticulture Industry Association (AmericanHort) American Standard for Nursery Stock (ANSI Z60.1-2014) for all standards of caliper size or height determination.
- The category of tree canopy spread for some species is provided in the GAR Plant List
- Single trunk trees shall have a minimum 1.5-inch caliper measurement taken 6 inches above the ground.
- Clump-form, multi-stem, and shrub-form trees shall have a minimum height of 8 feet.
- Height measurement shall be taken from ground level for field-grown stock and from the soil line for container-grown stock, which should be at or near the top of the root flare.

Plant Type and Landscape Element Category

For additional guidance, see the GAR Plant List for categorization by species.

Ground covers or other plants less than 2 feet tall at maturity:

- Shrubs, perennials, and ornamental grasses less than 2 feet tall
- Turf grass

Plants at least 2 feet tall at maturity:

- Shrubs, perennials, and ornamental grasses above 2 feet tall
- Trees with less than 1.5-inch caliper, multi-stem trees less than 8 feet tall, or new trees with soil volumes less than 400 cubic feet

Tree canopy for all new trees (including mature canopy spread less than, equal to, or greater than 40 feet):

- Species are determined with consideration for combined canopy spread and height
- Refer to the GAR Plant List for canopy spread of recommended species to find the associated minimum soil volumes
- Existing trees transplanted to new locations within a site will receive a multiplier equivalent to that of new trees

PLAN SUBMITTAL

In addition to complying with the standards described below, submitted GAR plans shall include the following:

- Plant location and spacing
- Plant size specified according to AmericanHort American Standards for Nursery Stock
- Plant species listed by common and scientific name
- Planting and other details illustrating soil depth, staking, planting hole, and vehicular traffic protection

CONSTRUCTION INSPECTION

The Certified Landscape Expert is responsible for confirming the following construction items meet the standards below prior to signing the Landscape Checklist:

- Plant material is installed at horticulturally appropriate times with consideration for weather, season, and site conditions.
- Plants are installed after topsoil has been confirmed to meet specifications.
- Plant material meets standards listed in the approved plan and the AmericanHort American Standard for Nursery Stock (ANSI Z60.1-2014).
- Plant installation is conducted according to industry standards and common horticultural practice, with all plant material in vigorous health at the time of planting and final inspection.
- Trees and shrubs must have a species identification tag from the nursery to remain on 2 of each planted species until the Landscape Checklist is signed, to be removed after inspection to prevent girdling.
- Plants are to receive proper post-installation watering and care.

STANDARDS

DESIGN

Plant Stock – Size and Quality Specifications

All plant material shall comply with the American Horticultural Society American Standard for Nursery Stock (ANSI Z60.1-2014). Considerations for plant material specifications include the following:

- Relationship between caliper, height, and branch number
- Size of the root ball or container
- Relation of root ball diameter and tree height
- Relation of ball depth to ball diameter
- Relation of container size to caliper height
- Annuals, bulbs, or plantings otherwise requiring annual replanting do not count for GAR credit unless used for food cultivation purposes
- Smaller caliper trees establish more quickly and have better survival rates than larger specimens; thus, larger-caliper trees should only be specified if there is dedicated maintenance during plant establishment
- Balled and burlapped (B&B), containerized, and bare root plants are all acceptable for planting; however, bare root material has a restricted planting season in comparison to B&B and containers

Location and Spacing

Plant spacing should be specified with consideration for a species mature spread as well as immediate visual impact.

- The plant spacing is species-specific. Canopy trees should be spaced to achieve the minimum tree soil volumes.
- Ground covers and plants above 2 feet tall shall be planted to provide full mature coverage at the time of planting. Refer to the GAR Plant List for recommended spacing by species. Perennials and grasses in containers should be spaced 12–24 inches apart, and plugs should be spaced a maximum of 12 inches on center. Species with greater spread should have an accordingly greater spacing.
- Shrubs planted under trees may receive full equivalent square footage; however, shrubs may not be planted within the root ball or root flare of trees.
- Ground cover may be planted underneath shrubs and trees; however, ground cover should not be planted within the root balls or existing root flare. Therefore, the root ball should not be included within the ground cover calculations.

Plant Protection Measures

Planting areas shall be protected from vehicular traffic. Examples of design for landscape area protection include, but are not limited to, wheel stops, curbs, bollards, and fencing.

Species Selection

Select species compatible with the cultural and design constraints of the site. Factors to consider include the following:

- Suitability to proposed soils
- Drainage
- Soil volume
- Availability of sunlight
- Wind exposure
- Plant habit in relation to circulation patterns and existing buildings or structures

During planting design, careful consideration should be given to maintenance needs. Plant compositions with species of diverse structural form, year-round cover, and site-appropriate selection typically provide lower-cost and lower-input maintenance. Invasive species may not be installed on GAR qualifying sites. Invasive species lists are provided in Section 5.11 Native Plants. Native species receive a bonus credit if meeting the standards of Section 5.11 Native Plants.

Tree Pit Opening

Tree pit openings should be large enough to prevent conflict between mature tree trunk flare and pavement, curb, tree grates, or other barriers. The tree pit opening should be at least 3 times the mature tree's trunk diameter at breast height or greater.

CONSTRUCTION

Planting Season, Weather, and Site Conditions

Plant material and seeding should be installed within designated planting seasons; however, weather and soil conditions may affect planting dates. No planting, seeding, or sod installation shall be done in frozen or snow-covered ground, wet soil, or when the soil is otherwise in an unsatisfactory condition for planting.

Recommended planting times are as follows:

- Deciduous plants – mid-October through May
- Evergreen plants – mid-March through May and September through November
- Turf grass seeding – March through April and mid-August through October
- Sod – all months (with irrigation)

Preparing the Planting Hole

If planting in existing uncompacted soils, excavate the planting hole to a minimum of 2 times the width of the rootball, then slope the sides outward to surrounding soils. In compacted soils, excavate the planting hole to a minimum of 3 times the width of the rootball, then slope outward to surrounding soils. Trees with limited opportunity to spread to surrounding soils, due to compaction under pavement or if planted in containers, should be designed with an enlarged soil volume and installed up to 36-inch depth. All newly planted B&B tree rootballs shall be placed directly over compacted subsoil.

Pruning

Prior to planting, inspect trees for dead, diseased, or crossing branches and prune accordingly. Remove co-dominant trunks and broken branches.

Plant Installation

All plant material shall be installed to the following standards:

Trees and Shrubs

- Confirm at least 2 structural roots, 4 inches from the trunk, are within the top 3 inches of the top of the root ball. If excess soil is present, raise the root ball and expose the trunk flare, or otherwise reject the plant material if remaining root volume is too limited. Place the root ball directly over subgrade to avoid settling.
- Remove the top 8–12 inches of the wire basket from B&B material to prevent future root girdling. Remove burlap from the top of the root ball. Synthetic burlap and rope are not allowed for planting.
- Inspect and remove girdling or circling roots prior to backfilling. Place tree irrigation bags or water wells over newly planted trees. Fill irrigation bags or otherwise irrigate new plantings to provide a minimum of 1 inch of water per week. Spread 3 inches of mulch over the root ball, but not in contact with the trunk.

Perennials and Ground covers

- Plant all material at or slightly above final grade. Backfill the planting holes with topsoil, tamp down, and water thoroughly.
- Spread 2 inches of mulch between plantings.

Turf grass

- Loosen, amend as necessary, and fine grade topsoil prior to seeding. If existing topsoil is compacted, rototill or use a similar method to decompact the material.
- After topsoil is loosened and scarified, place the seed, lightly rake into the soil, and roll for good soil-seed contact.
- Establish a full stand of grass for acceptance.

Staking

The necessity for tree staking is specific to individual trees and locations. Trees should be staked under the following conditions:

- Windy locations
- Trees subject to vandalism or mowing damage
- Trees subject to settlement in soil
- Large crown volume

Transplanting and Large Tree Planting

Tree transplanting should be done by a qualified contractor. Successfully transplanting larger trees requires greater care during installation. Experienced contractors and specialized equipment are necessary to perform this work. Refer to the American Horticultural Society American Standard for Nursery Stock (ANSI Z60.1-2014) for all root ball size standards and handling.

REFERENCES

- American National Standard Institute. 2012. "Part 6: Tree, Shrub, and Other Woody Plant Management Standard Practices (Planting and Transplanting)." In *ANSI A300*. Washington, DC: American National Standard.
- Harris, Richard W., James R. Clark, and Nelda P. Matheny. 2003. *Arboriculture: Integrated Management of Landscape Trees, Shrubs, and Vines (4th Edition)*. Prentice Hall.
- Horticulture Section, School of Integrative Plant Science, College of Agriculture and Life Sciences. "Transplanting Guide." In *Site Assessment and Tree Selection for Stress Tolerance*. Cornell University.
<http://www.hort.cornell.edu/uhi/outreach/recurbtrees/pdfs/17transguide.pdf>.
- Relf, Diane and Elizabeth Ball. 2009. *Perennials: Culture, Maintenance, and Propagation*. Virginia Tech. <http://pubs.ext.vt.edu/426/426-203/426-203.html>.
- Watson, Gary. 2014. *ISA Best Management Practices: Tree Planting, Second Edition*. International Society of Arboriculture.
- World Forestry Center in Portland. 1993. "A Technical Guide to Urban and Community Forestry." <http://www.na.fs.fed.us/spfo/pubs/uf/techguide/toc.htm>.

RESOURCES

- American Horticulture Industry Association d/b/a AmericanHort. 2014. "The American Standard for Nursery Stock (ANSI Z60.1)."

[https://americanhort.org/documents/ANSI Nursery Stock Standards AmericanHort 2014.pdf](https://americanhort.org/documents/ANSI_Nursery_Stock_Standards_AmericanHort_2014.pdf).

Swearingen, Jill, Britt Slattery, Kathryn Reshetiloff, and Susan Zwicker. 2010. *Plant Invaders of Mid-Atlantic Natural Areas, 4th Ed.* Washington, DC: National Park Service and U.S. Fish and Wildlife Service. <https://www.nps.gov/plants/alien/pubs/midatlantic/index.htm>.

5.4 Tree Preservation

The preferred method for increasing tree cover at a development site is to preserve existing trees, particularly where mature trees are present. Trees provide increasing environmental benefit as they mature. Established trees, however, may be impacted by careless site work during the construction process. Such impacts may result in tree death. Tree protection measures established during the design phase and followed throughout construction can provide a significant component of the GAR score.

INTEGRATION

Landscape elements that can be credited over the same surface area	Soils & Amendments	Bioretention	New & Existing Planting	Tree Preservation	Vegetated Walls	Vegetated Roofs	Permeable Paving	Enhanced Tree Growth	Renewable Energy	Water Features	Native Plants	Food Cultivation	Harvested Stormwater Irrigation
Tree Preservation													

RELATED ADMINISTRATIVE CONSIDERATIONS

DOEE Erosion and Sediment Control Manual.

DOEE Stormwater Management Guidebook, Section 3.14.1.

District Department of Transportation Urban Forestry Administration Special Tree Removal Permit, 24 DCMR Chapter 37, Public Space and Safety.

District of Columbia Municipal Regulations Zoning Tree Protection Guidelines, Title 11 Subtitle C § 400.

SUBMITTAL REQUIREMENTS

CALCULATING THE SCORE

The GAR score for tree preservation is based on the number and size of existing tree stock to be preserved. Each individual tree contributes an equivalent square footage as indicated in the following table.

GAR Landscape Elements	Equivalent Square Footage (ft ² per tree)
Tree canopy for preserved trees 6–12 inches in diameter	250
Tree canopy for preserved trees 12–18 inches in diameter	600
Tree canopy for preserved trees 18–24 inches in diameter	1,300
Tree canopy for preserved trees larger than 24 inches in diameter	2,000

The calculated equivalent square footage is then assigned a multiplier (listed below) based on tree size class. The multiplier times the equivalent square footage for a size class provides the calculated Green Area Ratio for preserved trees.

GAR Landscape Elements	Multiplier
Tree canopy for preservation of existing trees 6 inches to 24 inches in diameter	0.7
Tree canopy for preservation of existing trees 24 inches diameter or larger	0.8

Invasive tree species will not receive credit for preservation.

Standards of measurement

- Preserved trees will be measured by trunk diameter at breast height (DBH), 4.5 feet above ground level.
- Existing trees transplanted to new locations within a site will receive a multiplier score equivalent to that of new trees (see Section 4.3 New and Existing Plantings).

PLAN SUBMITTAL

In addition to complying with the standards described below, submitted GAR plans shall include the following:

- Submit a tree survey for all trees to be preserved, including location, species, trunk DBH, condition, and critical root zone (CRZ). This work must be done by a certified arborist or Maryland or Virginia licensed landscape architect with related experience, to properly assess the condition of the tree and CRZ.
- Prepare a tree preservation plan for all phases of construction activity. The tree preservation plan should be prepared and signed by a certified arborist or qualified Maryland or Virginia licensed landscape architect.
- Provide civil site plans (demolition, grading, utilities, and layout) illustrating extent of site work.

CONSTRUCTION INSPECTION

The Certified Landscape Expert is responsible for confirming the following construction items meet the standards below prior to signing the Landscape Checklist:

- Inspect tree protection measures throughout construction for protection of the root zone within the canopy dripline or CRZ.
- Monitor construction activity to prevent damage to tree canopy.

- Monitor trees for signs of decline or damage; revise design plans accordingly to maintain GAR score at completion of work.
- Monitor post-construction watering and care.

STANDARDS

DESIGN

Critical Root Zone

The CRZ is the minimum area of root zone underneath the tree canopy that must be protected from construction disturbance. The CRZ shall be a minimum 1.5-foot radius from the tree for every inch in trunk DBH, as specified in the DOEE Erosion and Sediment Control Manual, Chapter 9.

Existing trees are preserved during construction through a three-step process: inventory existing trees, prepare a tree preservation plan, and protect trees during construction.

***Step 1:* Inventory existing trees.**

The inventory must include a survey of existing trees and list their location, species, trunk DBH, and CRZ. The CRZ must also be identified on the plan. An ISA Certified Arborist shall determine the condition and suitability of proposed trees for preservation with consideration for structural integrity and biological health.

***Step 2:* Prepare a tree preservation plan.**

From the tree inventory, individual trees shall be identified for preservation and protection during site development. Trees selected for preservation and protection must be marked clearly, both on construction drawings and at the actual site.

The critical root zone or dripline shall be protected with durable and well-anchored fencing and shall remain throughout construction. The DDOT Standard Specifications for Highways and Structures 2009 describes the District's tree protection requirements under Section 611.07 Tree Protection and Replacement. The CRZ protection shall be marked on the site map. Stockpiling of material, construction activity, and grading are not allowed within the CRZ. Site disturbance within the CRZ is only permitted if done by hand tool, pneumatic excavation, or tunneling.

Within the CRZ of the tree, root soil protection measures are required, including surface protection mats with 12 inches of mulch. To preserve existing roots specify additional design approaches such as discontinuous footings or bridged curbs.

No grading operations are permitted within the CRZ. Raising or lowering the grade around the CRZ shall be minimized.

A licensed forester or arborist shall conduct an inventory of existing trees and forested areas at the development site before any site design, clearing, or construction takes place, as specified by the Urban Forestry Administration (UFA). An ISA Certified Arborist should determine tree condition and remove those deemed hazardous or in poor condition. The applicant is required to apply for a Special Tree Removal Permit from the Urban Forestry Administration depending on the trunk DBH.

Existing and proposed site conditions should be considered when determining which trees are suitable for preservation. Additional selection criteria includes: tree species, size, condition, and location (Table 6). Trees may not receive GAR credit if they are in poor condition or are listed in Section 5.11 Native Plants as an invasive species.

Table 6 Tree Preservation Criteria

Selection Criteria for Tree Preservation	Examples of Priority Tree and Forests to Conserve
Species	<ul style="list-style-type: none"> • Rare, threatened, or endangered species • Specimen trees • High quality tree species (e.g., trees that are structurally strong and live longer than other trees)
Size	<ul style="list-style-type: none"> • Trees over a specified diameter at breast height or other size measurement. • Trees designated as national, state, or local champions. • Contiguous forest stands of a specified minimum area.
Condition	<ul style="list-style-type: none"> • Healthy trees that are structurally sound. • High quality forest stands with high forest structural diversity
Location	<ul style="list-style-type: none"> • Trees located where they will provide direct benefits at the site (e.g., shading, privacy, windbreak, buffer from adjacent land use). • Forest stands that are connected to off-site forests that create wildlife habitat and corridors. • Trees located in protected natural areas such as floodplains, stream buffers, wetlands, erodible soils, critical habitat areas, and steep slopes. • Forest stands that are connected to off-site non-forested natural areas or protected land.

Additional Considerations

Secure an ISA Certified Arborist or professional forester to address additional measures related to tree management on construction sites.

Elevate low-hanging branches to protect against damage from construction equipment and prune dead, diseased, or otherwise hazardous branches from the tree canopy. Do not remove more than 20% of a tree canopy in any one year.

Responsible parties should address tree damage incurred during construction. Consult with a qualified professional for advice. Appropriate remedial measures for tree damage include irrigation, watering, vertical mulching, pneumatic decompaction and compost incorporation, or other appropriate measures depending on individual tree conditions.

CONSTRUCTION

Step 3: Protect trees during construction.

Physical barriers must be properly installed around the CRZ of trees that will be preserved. All tree protection measures must be installed before construction begins and maintained until construction is completed. Trees with CRZ protected by existing pavement must have trunk protection in place, such as 6-foot high wooden tree guards.

Discuss all tree protection measures at the preconstruction meeting.

Tree protection barriers include highly visible, well-anchored, temporary protection devices, such as 6-foot chain link, wire mesh, or wooden-slat snow fencing. Plastic mesh fencing is typically not appropriate for construction activity due to its limited durability.

For excavation anywhere within the CRZ, conduct hand or pneumatic excavation or tunneling beneath roots to limit root disturbance. Preserve roots greater than 2-inches in diameter. Where excavation must occur beyond the dripline and CRZ, prune roots to the edge of the excavation with a trenching machine, vibratory knife or rock saw and to a depth of 18 inches to allow a clean cut.

No stockpiling or storage of material is permitted within the CRZ/dripline.

REFERENCES

Fite, Kelby and Thomas Smiley. 2016. *Best Management Practices (BMP) - Managing Trees during Construction, Second Edition*. International Society of Arboriculture.

American National Standards Institute, 2012. "Part 5: Tree, Shrub, and Other Woody Plant Management Standard Practices (Management of Trees and Shrubs During Site Planning, Site Development, and Construction)." In *ANSI A300*. Washington, DC: American National Standard.

Cappiella, Karen, Tom Schueler, and Tiffany Wright. May 2006. *Urban Forestry Watershed Manual: Part 2. Conserving and Planting Trees at Development Sites*. Newtown Square: United States Department of Agriculture, Forest Service, Northeastern Area.
http://www.na.fs.fed.us/pubs/uf/watershed2/urban_watershed_forestry_manual_part2.pdf.

Doherty, Karen, David V. Bloniarz, H. Dennis, and P. Ryan. November 2003. "Positively the Pits! - Successful Strategies for Sustainable Streetscapes." *Tree Care Industry*, 14(11).
<http://www.umass.edu/urbantree/publications/pits.pdf>.

Matheny, Nelda P., and James R. Clark. 1998. *Trees and Development: A Technical Guide to Preservation of Trees During Land Development*. Champaign: International Society of Arboriculture.

Trowbridge, Peter J. and Nina L. Bassuk. 2004. *Trees in the Urban Landscape: Site Assessment, Design, and Installation*. Hoboken: John Wiley & Sons, Inc.

RESOURCES

Matheny, Nelda P., and James R. Clark. 1998. *Trees and Development: A Technical Guide to Preservation of Trees During Land Development*. Champaign: International Society of Arboriculture.

5.5 Vegetated Walls

Vegetated walls are vertical growing systems that help reduce the District's heat island effect and stormwater runoff, among other benefits. Climbing vines with vertical structural support and living walls with built-in-place growing media are design approaches that achieve credit as vegetated walls. Vegetated walls allow sites to gain credit using minimal site area.

INTEGRATION

Landscape elements that can be credited over the same surface area	Soils & Amendments	Bioretention	New & Existing Planting	Tree Preservation	Vegetated Walls	Vegetated Roofs	Permeable Paving	Enhanced Tree Growth	Renewable Energy	Water Features	Native Plants	Food Cultivation	Harvested Stormwater Irrigation
Vegetated Walls													

SUBMITTAL REQUIREMENTS

CALCULATING THE SCORE

To determine the score for vegetated walls, calculate the square footage of climbing vegetation along the vertical surface that is expected to have coverage 2–5 years from planting. The credited height for green facades is dependent upon the selected species and the vertical support surface, but shall not exceed 30 feet in height. For overhead structures on the horizontal plane, such as arbors or pergolas, the maximum credited area may not exceed 30 feet along the support surface. Living walls may be credited for height in excess of 30 feet.

GAR Landscape Elements	Multiplier
Vegetated Wall	0.6

PLAN SUBMITTAL

In addition to complying with the standards described below, submitted GAR plans shall include the following:

- Specify plant species, location, spacing, and size
- Specify detail and section, showing the area and type of support structure for vegetated wall plantings
- Specify setback dimensions from the property line, as necessary

- Where stormwater harvesting for irrigation is proposed, vegetated walls shall contain a connection to the proposed irrigation system
- Provide an irrigation plan or supplemental water location (i.e., hose bib)

CONSTRUCTION INSPECTION

The Certified Landscape Expert is responsible for reviewing the following construction items for accuracy prior to signing the Landscape Checklist:

- Area and spacing of plantings follow the approved plan
- Harvested stormwater irrigation system, where proposed, serves the vegetated wall
- Approved irrigation system is present for living wall
- Planting inspection and installation is in accordance with the standards listed in Section 5.3 New and Existing Plantings

STANDARDS

DESIGN

Vegetated walls should meet the following design criteria:

- Vegetated walls facing adjacent lots with zero lot-line development potential shall be at least 5 feet from a side or rear lot line.
- Vegetated walls shall be at least 5 or more feet from adjacent, facing structures to allow adequate light penetration.
- The vegetated wall setback does not apply to lot lines abutting streets or alleys.
- Vegetated walls should have a 5-foot clearance from all facing walls to allow adequate light penetration.
- Where stormwater harvesting for irrigation is proposed, vegetated walls shall contain a connection to the proposed irrigation system.
- All plant specifications should comply with the American Horticulture Industry Association American Standards for Nursery Stock and requirements listed in Section 5.3 New and Existing Plantings.
- Green facades shall provide a minimum of 1 cubic foot of soil per 10 square feet of credited green façade.
- Plantings on green facades should be spaced no greater than 4 feet on center to be credited for continuous wall coverage.

- See the “Green Facades” section for additional guidance on plant spacing.
- Living walls require permanent irrigation.
- Vines with a tendril or twining attachment require a cable or lattice system.
- Vines with clinging structures may attach directly to the wall surface.

There are 3 major categories of vegetated walls:

1. Green Facades

Green facades or green screens are systems that grow vertically from a planter or soil bed at the base of the structure. Alternatively, green facades may cascade down a wall from a planting bed situated on the rooftop. Green facades may include vines, other climbing plants, cascading ground covers, and espaliered trees.

Green facades are supported by an underlying structure designed for the location. Support structures may be freestanding or attached to a wall (e.g., cable or trellis systems).

Green facades can take several seasons to reach maturity. This depends on the climate, plant choice, depth of soil bed, orientation (south facing facades are ideal), nutrition, and irrigation system.

Recommended plant spacing for green facades varies by container size:

- #1 container, 18–24 inches on center
- #3 container, 24–36 inches on center
- #5 container, 36–48 inches on center
- #7 container, 48 inches on center

Cable systems are appropriate for twining plants. Trellis systems are appropriate for vines that cling or climb with tendrils or suckers. Cable systems should have one plant per cable.

2. Living Walls

Living walls are systems composed of vegetated panels, modules, plugs, planted blankets, or bags that are attached to an existing structural wall or freestanding structure. A living wall is essentially a green roof turned on its side.

Living wall modules can be made of plastic, expanded polystyrene, synthetic fabric, clay, or concrete. Their design typically includes a dense and diverse mix of plants, such as ferns, low shrubs, perennial flowers, and edible plants. The wide variety of plant options helps living walls thrive in full sun, shade, and interior applications.

Living walls require supplemental irrigation to compensate for limited soil volume in the trays. The original irrigation specification should also include a recommended initial irrigation frequency and time, based upon the season and plant requirements.

3. Retaining Living Walls

Retaining walls with built-in growing media do not qualify for credit under this item. Refer to Section 5.3 New and Existing Plantings for additional guidance.



Cable system, 2nd Street NE



Trellis system, H Street NW



Living wall by Tournesol Siteworks

CONSTRUCTION

Vegetated wall system construction should follow applicable DCRA building codes, as well as manufacturer specifications.

REFERENCES

Arsenault, Peter. 2013. *Green Walls: Integrating Nature Into Buildings*. Architectural Record Continuing Education Center.

Green Roofs for Healthy Cities. "About Green Walls." <https://www.greenroofs.org/about-green-walls/>.

Greenscreen. September 2012. "Considerations for Advanced Green Facade Design." http://greenscreen.com/docs/Education/greenscreen_Advanced%20Green%20Facade%20Design_CEU.pdf.

5.6 Vegetated Roofs

Vegetated roofs enable sites with significant building footprints to achieve GAR compliance. Vegetated roofs over occupied buildings, parking decks, or other structures are all applicable under this item. Vegetated roofs can also be used for food cultivation.

INTEGRATION

Landscape elements that can be credited over same surface area	Soils & Amendments	Bioretention	New & Existing Planting	Tree Preservation	Vegetated Walls	Vegetated Roofs	Permeable Paving	Enhanced Tree Growth	Renewable Energy	Water Features	Native Plants	Food Cultivation	Harvested Stormwater Irrigation
Vegetated Roofs													

RELATED ADMINISTRATIVE CONSIDERATIONS

DOEE Stormwater Management Guidebook, Section 3.2 Green Roofs.

SUBMITTAL REQUIREMENTS

CALCULATING THE SCORE

- Vegetated roofs are calculated by first determining the square footage of vegetated surface area. The vegetated roofs' landscape features are divided into 2 categories, extensive and intensive.
- Each category is assigned a multiplier. An intensive vegetated roof is assigned a larger value than an extensive roof due to the increased depth and associated environmental benefits (e.g., greater stormwater retention, greater plant diversity, higher rate of evapotranspiration).
- Ground cover plants less than 2 feet tall on the vegetated roof are ineligible for additional credit beyond the vegetated roof landscape element. Plants greater than 2 feet tall will provide additional credit if adequate soil depth is provided to specified plantings.
- To calculate credited depth, measure the depth of the growing media. Growing media with a depth 1 inch or greater and less than 2 inches may be credited if supplied with an additional water-retention layer with a depth of 1 inch or greater.
- Vegetated roofs may be fully credited when used in combination with solar elements. Refer to the DOEE Stormwater Management Guidebook for solar clearance and spacing requirements.
- Container plantings over a structure may be credited as vegetated roof. See Section 5.1 Soils and Amendments regarding plant soil depths in addition to the following plan submittal design requirements.

GAR Landscape Elements	Multiplier
Extensive vegetated roof with growing media greater than 2 inches and less than 8 inches	0.6
Intensive vegetated roof with growing media 8 inches or greater	0.8

PLAN SUBMITTAL

In addition to complying with the standards described below, submitted GAR plans shall include the following:

- Dimensions of soil, showing area and depth
- Vegetated roof details and specs
- Plant species, size, spacing (if installing prevegetated mats, include the percent coverage of plugs per tray), type of root system, and location
- Source, type, and location of supplemental water to vegetated roof
- Signed statement by structural engineer confirming the existing or proposed roof can support a vegetated roof
- Roof drainage and overflow plan
- Identify vegetated roof access for maintenance

CONSTRUCTION INSPECTION

The CLE is responsible for reviewing the following construction items meet the standards below prior to signing the Landscape Checklist:

- Area of vegetated roof vegetation and depth of soil
- Quality of vegetative stock during installation and establishment
- Installation of irrigation and drainage features for the vegetated roof, as required

STANDARDS

DESIGN

Design of vegetated roofs includes the deck layer, leak-detection system, waterproofing layer, insulation layer, root barrier, drainage layer, filter fabric, growing media, and plant materials. In association with other required professionals, the Certified Landscape Expert (CLE) will review the drainage layer, growing media, and plant materials for proper design:

- Designs for vegetated roofs must include supplemental water.
- Vegetated roofs shall contain a connection to the harvested stormwater when stormwater harvesting is proposed for irrigation.

- Plants can be established using cuttings, plugs, mats, or containers and should achieve 80% minimum coverage after 2 years.
- The minimum spacing for succulent plantings is 2 plugs per square foot and 10 pounds of cuttings per 100 square feet.
- All green roofs must follow the minimum feasibility and design criteria outlined in the DOEE Stormwater Management Guidebook.
- Runoff and retention calculations are not required if a stormwater management plan review is not required.
- If a stormwater management plan is required, coordinate with the project engineers to ensure that all stormwater management practices are consistent on all submitted documents.

Supplemental Water

Hardy succulent plant species do not typically require permanent irrigation. Drought-tolerant grasses and herbaceous plant species may also be selected for non-irrigated roofs (see Table 7). Temporary irrigation is recommended for plant establishment and watering in drought conditions. Plant communities selected for drought tolerance without irrigation are preferred over plant species that require a connection to the potable water supply.

A vegetated roof requires a permanent, supplemental irrigation system such as drip, spray, or sub-irrigation methods if the plantings are not adaptable to drought conditions, are exposed to heavy wind, or are planted on a slope above 15%. A permanent irrigation connection to the vegetated roof is necessary for sites that propose harvested rainwater irrigation. In porous vegetated roof growing media, spray irrigation provides effective coverage (Rowe, 2014) but requires treatment if provided through harvested rainwater collection. For smaller vegetated roofs, such as those less than 1,000 square feet, a hose bib connection may be an acceptable but less-reliable source for permanent irrigation.

Table 7 Vegetated Roof Plant Coverage Guidelines at Time of Installation

Vegetated Roof Coverage for Plant Species ³			Credited Categories			
Growing Media Depth ¹	No Permanent Irrigation	Permanent Irrigation	Vegetated Roof C1 = < 8 in. C2 = ≥ 8 in.	Native ⁴ (F1)	Ground cover (B1)	Plant ≥ 2 ft (B2)
2"–4" ²	Succulents Non-succulents (≤ 20% cover)	Succulents Non-succulents (≤ 40% cover)	C1	30% max	No Vegetated roof multiplier includes ground cover	No
4"–8"	Succulents-Grasses-Herbaceous Non-succulents (≤ 60% cover)	Succulents-Grasses-Herbaceous		60% max		
8"–12"	Succulents-Grasses-Herbaceous	Succulents-Grasses-Herbaceous - Small Shrubs	C2	100% max		Yes
12"–24"		Grasses-Herbaceous-Shrubs				
24"+		Grasses-Herbaceous-Shrubs-Trees				

¹ Growing media consists of 70%–80% inorganic material and a maximum of 30% organic matter by volume. Growing media shall be capable of supplying all of the following in quantities sufficient to support plant growth: nutrient supply, water-holding capacity, drainage, root support, and ballast.

² Growing media less than 4 inches deep should have a water-retention layer 0.5 inches thick or greater unless otherwise provided with permanent irrigation. Growing media with a depth of 1 inch or greater and less than 2 inches may be credited if supplied with a water-retention layer 1 inch or greater. Only succulents may be specified and non-natives credited at less than 2-inch depth of growing media.

³ Planting designs shall have a minimum of 5–7 species evenly mixed throughout the area to ensure suitability to varied rooftop microclimates. Non-succulent species in non-irrigated or shallow growing media should have demonstrated drought tolerance for vegetated roof conditions (refer to the GAR Plant List for species recommendations).

⁴ Individual native species may compose no more than 20% of total vegetated roof coverage.

Plant Selection

Succulent species are ideally suited to shallow growing media and unirrigated vegetated roofs. Deeper soil depth and irrigation allow for a greater selection of plant species. Mixing vegetation types, such as sedum, grass, and herbaceous plantings, can provide greater evapotranspiration and habitat value than using a single type (Nagase, Dunnett, 2012). According to Weber,

Nagase, and others, increased plant height correlates with greater water retention, particulate matter accumulation, and cooling (Sutton, 2015). Refer to the GAR Plant List for recommended species.

CONSTRUCTION

Follow the Green Roof Construction Sequence guidelines outlined in the DOEE Stormwater Management Guidebook, Section 3.2.6.

REFERENCES

District of Columbia Department of Energy and Environment. 2013. "Green Roofs." In *DOEE Stormwater Management Guidebook*. 29-41. Washington, DC.

Michigan State University. "Michigan State University Green Roof Plant Evaluations."
<http://www.hrt.msu.edu/greenroof/research-projects/plant-evaluations.html>.

Nagase, Ayako and Nigel Dunnett. 2012. *Amount of Water Runoff From Different Vegetation Types on Extensive Green Roofs: Effect of Plant Species, Diversity, and Plant Structure*. Landscape and Urban Planning.

Rowe, D. Bradley, Matthew R. Kolp, Sarah E. Greer, and Kristin L. Getter. 2014. *Comparison of Irrigation Efficiency and Plant Health of Overhead, Drip, and Sub-irrigation for Extensive Green Roofs*. Ecological Engineering. <https://doi.org/10.1016/j.ecoleng.2013.12.052>.

Sutton, Richard K. (Ed.). 2015. *Green Roof Ecosystems*, Cham, Switzerland: Springer International Publishing AG.

5.7 Permeable Paving

Permeable paving is a system that captures and temporarily stores stormwater by filtering the runoff through voids in the pavement surface and underlying stone reservoir layer or subgrade. Permeable paving systems may also provide additional soil-water to plants. GAR divides permeable paving into 2 categories based on depth of soil or gravel.

INTEGRATION

Landscape elements that can be credited over the same surface area	Soils & Amendments	Bioretention	New & Existing Plantings	Tree Preservation	Vegetated Walls	Vegetated Roofs	Permeable Paving	Enhanced Tree Growth	Renewable Energy	Water Features	Native Plants	Food Cultivation	Harvested Stormwater Irrigation
Permeable Paving													

RELATED ADMINISTRATIVE CONSIDERATIONS

DOEE Stormwater Management Guidebook, Section 3.5 Permeable Pavement Systems.

SUBMITTAL REQUIREMENTS

CALCULATING THE SCORE

- These areas are credited by square feet (length × width).
- Permeable paving and enhanced tree growth may not count for more than 1/3 of the total GAR score for the lot.

GAR Landscape Elements	Multiplier
Permeable paving over at least 6-inches and less than 2-feet of soil or gravel	0.4
Permeable paving over at least 2-feet of soil or gravel	0.5

PLAN SUBMITTAL

In addition to complying with the standards described below, submitted GAR plans shall include the following:

- Plan and details with dimensions, showing depth, area, type of permeable paving, underdrain and where it connects to the storm sewer (if applicable), and observation wells

- Detail illustrating the permeable paving profile with pavement type, as well as reservoir depth and material type
- For permeable paving over a structure, a schematic plan illustrating the flow path of stormwater with the location and type of controlled-flow roof drains
- An approved infiltration test as defined in the DOEE Stormwater Management Guidebook, if claiming the soils allow infiltration

CONSTRUCTION INSPECTION

The CLE is responsible for reviewing the following construction items meet the standards below prior to signing the Landscape Checklist:

- Total square footage of permeable paving systems
- Depth of reservoir (gravel/soil) layer as per plan
- Full establishment of grass for vegetated permeable paving areas

Practices and Standards

Supervision before, during, and after construction by a qualified professional is recommended for permeable paving systems to ensure the facilitates are constructed in accordance with the manufacturer's specifications and the District of Columbia stormwater management regulations (see the Permeable Pavement Construction Checklist in the DOEE Stormwater Management Guidebook, Appendix K).

STANDARDS

DESIGN

Design of the permeable paving system includes geotextile, base material components, underdrain (if required), stone media, reservoir media, bedding layer, paving material, observation wells, and in some cases vegetated cover. Specify permeable paving within an impervious contributing drainage area for minimal maintenance requirements. In association with other required professionals, the Certified Landscape Expert (CLE) will review the reservoir layer depth (aggregate or soil) for permeable paving as well as soil quality and turf establishment for vegetated pavers.

Permeable paving must be a surface that facilitates water infiltration through paving material while providing a stable, load-bearing surface. Examples of acceptable practices include porous asphalt, porous concrete, porous pavers, perforated brick pavers, vegetated permeable paving such as mechanically reinforced grass, permeable paving over enhanced tree growth systems, flexible porous paving, or other proprietary practices. Permeable paving does not include grass or gravel.

Vegetated permeable paving should only be used in low-traffic situations, such as temporary overflow parking. Do not specify vegetated permeable paving for areas with high traffic because turf grass will perform poorly.

All permeable paving systems must follow the minimum feasibility, pretreatment, and design criteria provided in the DOEE Stormwater Management Guidebook, Section 3.5 Permeable Pavement Systems. Runoff and retention calculations are not required if the project does not require a stormwater management plan. If a stormwater management plan is required, coordinate with the project engineers to ensure that all stormwater management practices are consistent on all submitted documents.

Standard Design - Practices with a standard underdrain design and no infiltration sump or with a water quality filter that is sized to drain the system in 36 to 48 hours (see DOEE Stormwater Management Guidebook, Figure 3.11).

Enhanced Design with an Underdrain - Practices that contain a water quality filter layer and an infiltration sump beneath the underdrain that is sized to drain the system in 36 to 48 hours (see DOEE Stormwater Management Guidebook, Figures 3.12).

Enhanced Design without an Underdrain - Practices that infiltrate the design storm volume in 48 hours (see DOEE Stormwater Management Guidebook, Figure 3.13).

Permeable paving systems are not typically designed to provide stormwater detention for larger storms (e.g., 2-year, 15-year) and are generally combined with other stormwater best management practices (BMPs) where detention is required.

CONSTRUCTION

Follow the Permeable Pavement Construction Sequence guidelines outlined in the DOEE Stormwater Management Guidebook, Section 3.5.6.

REFERENCES

District of Columbia Department of Energy and Environment. 2013. "Permeable Pavement Systems." In *DOEE Stormwater Management Guidebook*. 79-98. Washington, DC.

District of Columbia Department of Energy and Environment. 2013. "Appendix O Geotechnical Information Requirements for Underground BMPs." In *DOEE Stormwater Management Guidebook*. O-1 – O-4. Washington, DC.

United States. Environmental Protection Agency. "National Menu of Stormwater Best Management Practices. 2009-09-10. Porous Asphalt Pavement" Retrieved 18 September 2012. <https://www.epa.gov/npdes/national-menu-best-management-practices-bmps-stormwater#edu>.

5.8 Enhanced Tree Growth Systems

Enhanced tree growth consists of soil techniques designed to transfer the load from pavement directly to the subsoil rather than the topsoil. These systems promote more soil volume for tree roots than is otherwise available under conventional pavement systems.

INTEGRATION

Landscape elements that can be credited over the same surface area	Soils & Amendments	Bioretention	New & Existing Planting	Tree Preservation	Vegetated Walls	Vegetated Roofs	Permeable Paving	Enhanced Tree Growth	Renewable Energy	Water Features	Native Plants	Food Cultivation	Harvested Stormwater Irrigation
Enhanced Tree Growth													

RELATED ADMINISTRATIVE CONSIDERATIONS

In the DOEE Stormwater Management Guidebook, Chapter 3 Bioretention, engineered tree boxes use the same design strategy as Enhanced Tree Growth.

SUBMITTAL REQUIREMENTS

CALCULATING THE SCORE

- These areas are credited by square feet (length × width)
- Enhanced Tree Growth and Permeable Paving may not count for more than 1/3 of the total GAR score for the lot

GAR Landscape Elements	Multiplier
Enhanced Tree Growth	0.4

PLAN SUBMITTAL

In addition to complying with the standards described below, submitted GAR plans shall include the following:

- Provide plan and details, with associated dimensions and area
- Identify irrigation associated with enhanced tree growth system

CONSTRUCTION INSPECTION

The Certified Landscape Expert is responsible for reviewing the following construction items meet the standards below prior to signing the Landscape Checklist:

- Total square footage of the enhanced tree growth system
- Installation of soil to the specified depth
- Installation of proposed irrigation and drainage if necessary
- Compatibility of delivered topsoil or structural soil with the standard or proprietary specification

STANDARDS

First consider enlarging at-grade soil volumes for trees where feasible before selecting an enhanced tree growth system. This practice is particularly appropriate where pedestrian or vehicular activity would otherwise compact the soil in tree pits. A number of approaches can be followed to enhance tree root growth through modification of the structural supports underneath pavement. Of these approaches, the most common systems are suspended pavements, sand-based structural soil, and aggregate structural soil.

DESIGN

The following design standards should be followed to receive credit:

- Provide a minimum 24-inch depth of soil
- Use in locations underneath pavement and connected to adjacent planting areas
- The materials used for these systems should be neither contaminated, nor compacted, according to the Comprehensive Environmental Response, Compensation, and Liability Act of 1980
- All enhanced tree soil systems must follow the minimum feasibility, pretreatment, and design criteria for engineered trees boxes provided in the DOEE Stormwater Management Guidebook, Section 3.6 Bioretention



Enhanced tree growth and bioretention in NoMa, NE DC.

Enhanced tree growth systems should be designed to provide minimum tree openings 2–3 times the mature tree’s trunk diameter at breast height. Consider placing permeable paving or drain inlets with perforated pipe irrigation under pavement.

Suspended pavements - Support pavement through columns or walls, allowing soil placed within the suspended pavements to remain at a compaction level suitable to root growth. Both proprietary and non-proprietary devices are available.

Sand-based structural soil systems - Includes pavement over open-graded crushed stone and sand-based structural soil. Due to the poor water retention capacity of sand, an additional water source is necessary, provided by drainage channels or permeable pavers. Such systems should be designed with passive irrigation only. Additional guidance can be found in the DDOT Green Infrastructure Standards.

Aggregate structural soils - Consist of angular gravels that directly support pavement but through which roots may grow. These systems are constructed from load-bearing materials such as aggregate and clay-loam mix or expanded slate with clay-loam mix. Aggregate Structural Soils shall be used as a pathway for roots to reach additional soil volumes across pavement subsurface and not as the only available tree soil volume.

CONSTRUCTION

Suspended pavements – Topsoil in suspended pavement structures do not support the pavement above. These soils are compacted at a lower rate than that of structural fill, allowing for root growth while still providing a stable soil substrate for trees.

Sand-based structural soil – The sand-based soil is compacted to support overlaying pavement. Inspect the proposed irrigation system as well. Additional guidance can be found in the DDOT Green Infrastructure Standards.

Aggregate structural soils – Because a number of proprietary devices are available, it is necessary to follow the manufacturer’s guidelines. Purchase aggregate structural soils from licensed suppliers and follow the recommended installation procedures.

Supervision before, during, and after construction should be performed by a qualified professional.

REFERENCES

American Society of Landscape Architects. 2009. “The Great Soil Debate: Understanding Competing Approaches to Soil Design.” ASLA Annual Meeting Handout, Chicago, Illinois, September 20.

American Society of Landscape Architects. 2010. “The Great Soil Debate Part II: Structural Soils Under Pavement.” ASLA Annual Meeting Handout, Washington, District of Columbia, September 11.

District Department of Transportation. 2014. “DDOT Green Infrastructure Standards.” <http://ddot.dc.gov/node/818592>.

Urban, James. 2008. *Up By Roots: Healthy Soils and Trees in the Built Environment*. Madison: International Society of Arboriculture.

5.9 Renewable Energy

Because there is limited wind potential in the District of Columbia, the primary renewable energy technologies with widespread applicability for GAR are rooftop- and ground-mounted solar photovoltaic (PV) and solar thermal systems. These systems are designed as an alternative energy source that provides long-term financial and environmental benefits and reduces the use of conventional fuels.

INTEGRATION

Landscape elements that can be credited over the same surface area	Soils & Amendments	Bioretention	New & Existing Planting	Tree Preservation	Vegetated Walls	Vegetated Roofs	Permeable Paving	Enhanced Tree Growth	Renewable Energy	Water Features	Native Plants	Food Cultivation	Harvested Stormwater Irrigation
Renewable Energy													

RELATED ADMINISTRATIVE CONSIDERATIONS

Solar project plan designs must be submitted to the Department of Consumer and Regulatory Affairs (DCRA) Planning and Zoning officials for review and approval to ensure compliance with building codes and zoning regulations. Projects in historic districts will require additional review by the Historic Preservation Review Board. Upon approval, permits for building and electrical or plumbing are provided for each project. These approvals are required before installation.

SUBMITTAL REQUIREMENTS

SCORE DETERMINATION

Only solar PV and solar thermal systems are credited under the renewable energy landscape element. The solar PV and thermal system score is calculated by multiplying the square footage of the array by the element multiplier assigned below.

GAR Landscape Elements	Multiplier
Renewable energy	0.5

PLAN SUBMITTAL

In addition to complying with the standards described below, submitted GAR plans shall include the following:

- Reference note on GAR plan sheet listing all electrical, plumbing, mechanical, or other relevant plan sheet details and specifications that are part of the total building permit approval. Also provide the solar supplemental permit number to aid plan review.

- A copy of plan documents for project electrical, plumbing, and building permitting must be provided, including the site plan with drawings showing the solar array, number of collectors or panels, system size, array dimensions, and location of the array and mounting.
- Schematic diagram showing the balance of system components (system wiring, disconnects, inverter(s), valves, pipes, tanks, and pumps). To aid review, also provide the solar PV panel specification sheet and solar thermal OG 100 collector rating specification sheet or OG 300 system rating specification sheet.
- Shading analysis, which is used to determine the most efficient and economical array position. Request this analysis from the solar professional if more than 20% shading exists on the array location. More information is available at <http://www.buiditsolar.com/References/SunChartRS.htm>.

CONSTRUCTION INSPECTION

Prior to signing the Landscape Checklist, the Certified Landscape Expert (CLE) is responsible for meeting with the contractor to visually verify that the system size and components are present per the GAR plan.

Qualified professionals should supervise the work before, during, and after construction. Certified solar energy professionals have training and experience with the required safety, electrical, plumbing, and building codes and standards required by the authority that has jurisdiction to install or inspect systems. Visit <http://www.nabcep.org/> for more information about certification requirements for solar professionals. A certified, licensed, bonded, and experienced solar installer should be consulted for commercial systems. Electrical wiring for pumps and monitoring systems is typically more complicated for commercial-scale systems.

Qualified professionals for solar systems include, but are not limited to the following:

- Master Plumbers
- Master Electricians
- Licensed Carpenters/Roofers
- Professional Engineers
- Certified Solar Energy Professionals

STANDARDS

DESIGN

The solar element may be a permanent fixture or a contractually time-limited installation such as through a power purchase agreement. The array and components must be installed prior to inspection, and the minimum GAR score must be maintained if the solar elements are removed at a later time.

Solar Photovoltaics

The Solar America Board for Codes and Standards is the national best practices organization for solar PV codes and standards. This organization tracks, evaluates, and provides industry collaboration on improving and standardizing solar codes and standards for industry professionals. Visit <http://www.solarabcs.org/codes-standards/IAPMO/index.html>.



Solar Thermal Systems

Solar heaters or solar thermal systems provide clean heat energy for water or space heating. The systems collect the sun's energy to heat air or a fluid. The Solar Rating and Certification Corporation (SRCC) and the Florida Solar Energy Center (FSEC) certify and rate solar thermal systems and equipment. SRCC has a directory of certified systems along with system performance ratings on their web site for use in comparing both individual collectors and complete systems, <http://www.solar-rating.org/>.



The design of a PV or solar thermal system is generally based on unshaded access to the sun's radiant energy, site orientation relative to the sun, and structural capacity of the site hosting

the solar collection modules or panels. The following steps are required to complete design and installation of solar systems in the District of Columbia.

For solar PV systems, the electrical professional (design engineer, contractor, or installer) is responsible for the following:

1. Site evaluation – Engineer determines available daily solar resource and how much energy can be produced from a given site.
2. System design – Engineer/system designer determines system size (number of modules), array's geographic orientation, inverter type, balance of system components, the tilt/azimuth of solar panels to maximize performance, integration with vegetated roofing systems, etc.
3. Installation – Contractor or installer obtains design approval through DCRA zoning, building, and electrical permits and historic preservation office (if required). Designs must be approved before installation. Contractor or installer submits utility grid interconnection application (complete with system capacity and approved DCRA plans) to Pepco for request to interconnect.

For solar thermal systems, the heating professional (design engineer, contractor, or installer) is responsible for the following:

1. Site evaluation – The type of system, including the type of thermal collector and whether it is active or passive, depends on several factors. These include proposed site, local climate, installation considerations (distance of pipe runs, building height, pressure, flow rates, existing building construction, etc.), cost, and the use of the solar heating system (domestic water or space heating).
2. System design – Engineer/system designer determines system size (number of collectors); location; and number and type of piping, control valves, storage tanks, circulating pumps (active systems), controls (active systems), and British thermal unit (Btu) meters.
3. Installation – Contractor or installer obtains design approval through DCRA zoning, building, and plumbing permits. Electrical permitting may be required for larger active systems. DCRA plan reviewers make the determination if the system is designed according to DC standards and notify the installer who submitted the plan. Upon plan approval, a master plumber/engineer finalizes system installation and interconnection to the building's plumbing.

CONSTRUCTION

Solar photovoltaics and solar thermal systems should comply with the applicable DCRA building codes.

RESOURCES

Pepco. "District of Columbia Interconnection Application and Agreement Form."
<http://www.pepco.com/nem-interconnection-application-and-agreement.aspx>.

REFERENCES

District of Columbia Department of Consumer and Regulatory Affairs. "Solar Permitting Guidelines." <https://dcra.dc.gov/node/1179114>.

District of Columbia Department of Consumer and Regulatory Affairs. "Build Green DC-Solar." <https://www.buildgreendc.org/solar/>.

District of Columbia Department of Energy and Environment. "Energy in the District." <https://doee.dc.gov/energy>.

District of Columbia Department of Energy and Environment. "Solar Initiatives." <https://doee.dc.gov/solar>.

Pepco. "Green Power Connection." <http://www.pepco.com/greenpowerconnection>.

United States Department of Energy. "Installing and Maintaining a Home Solar Electric System." <http://energy.gov/energysaver/articles/installing-and-maintaining-home-solar-electric-system>.

United States Department of Energy. "Solar Water Heating System Maintenance and Repair." <http://energy.gov/energysaver/articles/solar-water-heating-system-maintenance-and-repair>.

United States Department of Energy. "Solar Water Heaters." <http://energy.gov/energysaver/articles/solar-water-heaters>.

5.10 Water Features

Water features consist of amenities such as fountains, pools, or other constructed elements.

INTEGRATION

Landscape elements that can be credited over the same surface area	Soils & Amendments	Bioretention	New & Existing Planting	Tree Preservation	Vegetated Walls	Vegetated Roofs	Permeable Paving	Enhanced Tree Growth	Renewable Energy	Water Features	Native Plants	Food Cultivation	Harvested Stormwater Irrigation
Water Features													

RELATED ADMINISTRATIVE CONSIDERATIONS

DOEE Stormwater Management Guidebook, Section 3.3 Rainwater Harvesting and Appendix M Tiered Risk Assessment Management: Water Quality End Use Standards.

The DC Plumbing Construction Code provides additional guidance on the uses of potable and non-potable water sources for the design and construction of water features.

SUBMITTAL REQUIREMENTS

CALCULATING THE SCORE

Measure water features by the area of the site covered with water at least 6 months of the year.

GAR Landscape Elements	Multiplier
Water features	0.2

PLAN SUBMITTAL

In addition to complying with the standards described below, submitted GAR plans shall include the following:

- Plumbing and drainage plan – The drawings must demonstrate that harvested stormwater provides at least 50% of annual water flow. Provide a water budget indicating the percentage of water demand met by rainwater, calculated on a monthly and annual basis.
- Plans and details with associated dimensions - The drawings must demonstrate the area of the landscape element covered with water a minimum 6 months of the year.

If a stormwater management plan is required, coordinate with the project engineers to ensure that all stormwater management practices are consistent on all submitted documents.

CONSTRUCTION INSPECTION

The Certified Landscape Expert is responsible for reviewing the following construction items meet the standards below prior to signing the Landscape Checklist:

- Confirm the credited water coverage area upon completion of construction
- Test the system during the final inspection, if feasible

STANDARDS

DESIGN

Water features should meet the following standards to receive credit:

- The credited area of the landscape element must be covered with water a minimum 6 months of the year.
- Harvested rainwater must provide at minimum 50% of the annual flow.
- Water must recirculate in the system to conserve water and inhibit mosquito breeding.
- If no stormwater management plan is required for the credited element, the project must still follow the stormwater management guidelines for harvested rainwater as outlined in the DOEE Stormwater Management Guidebook, Section 3.3 Rainwater Harvesting.

District of Columbia Construction Code – Comply with all relevant sections of the Plumbing, Mechanical, and Green Construction Code for water feature design and construction. Refer to appropriate standards for potable water connections, installation, insect and vermin control, drainage, freeze protection, trenching requirements, rainwater catchment and collection systems, tests and inspections, operations and maintenance manuals, discharge system, metering, and other necessary features.

Harvested rainwater storage devices – Cisterns must be designed by a qualified professional with consideration for the size, location, filtration, pump type, construction material, and contributing drainage area. For additional guidance, refer to the DOEE Stormwater Management Guidebook, Section 3.3 and Appendix M.

Water quality and risk assessment – The DOEE Stormwater Management Guidebook, Appendix M, details the process for the designer and owner to evaluate health risks and treatment standards for harvested stormwater based on collection surfaces, proposed uses, and exposure pathways. Oversight of the Tiered Risk Assessment process and water treatment measures fall outside the scope of the Green Area Ratio (GAR). Any proposed GAR water features also

outside the scope of the District's stormwater management regulations must be independently assessed by the project applicant for associated health risk.

CONSTRUCTION

Follow the Rainwater Harvesting Construction Sequence guidelines outlined in the DOEE Stormwater Management Guidebook, Section 3.3.6.

REFERENCES

District of Columbia Department of Energy and Environment. 2013. "Rainwater Harvesting." In *DOEE Stormwater Management Guidebook*. 43-65. Washington, DC.

District of Columbia Department of Energy and Environment. 2013. "Appendix M Tiered Risk Assessment Management: Water Quality End Use Standards." In *DOEE Stormwater Management Guidebook*. M-1 – M-20. Washington, DC.

5.11 Native Plants

Native plant species provide an additional environmental benefit beyond that of non-native plants. Likewise, the landscape element “Native Plants” provides additional GAR credit above that of already-credited planting landscape elements.

INTEGRATION

Bonus to the following landscape elements	Soils & Amendments	Bioretention	New & Existing Planting	Tree Preservation	Vegetated Walls	Vegetated Roofs	Permeable Paving	Enhanced Tree Growth	Renewable Energy	Water Features	Native Plants	Food Cultivation	Harvested Stormwater Irrigation
Native Plants													

SUBMITTAL REQUIREMENTS

CALCULATING THE SCORE

Native Plants are a bonus feature; as such, determine the cumulative square footage of all native plantings already credited under the below-listed landscape elements.

Green Area Ratio Landscape Elements	Equivalent Square Footage (ft ² per plant/tree)
Ground covers, or other plants less than 2 feet tall at maturity	Square footage at maturity
Plants at least 2 feet tall at maturity	9
Tree canopy for new trees with less than 40-foot canopy spread	50
Tree canopy for new trees with 40-foot or greater canopy spread, and preserved trees 6–12 inches in diameter	250
Tree canopy for preserved trees 12–18 inches in diameter	600
Tree canopy for preserved trees 18–24 inches in diameter	1,300
Tree canopy for preserved trees larger than 24 inches in diameter	2,000

The cumulative square footage is then computed using the 0.1 multiplier.

GAR Landscape Elements	Multiplier
Native plant species listed in Subtitle C § 603.9 (Bonus)	0.1

For example, the native bonus for 1,000 square feet of ground cover; 20 shrubs, 5 trees (with less than 40-foot canopy); 10% ground cover on a 1,000-square-foot vegetated roof with 8-inch depth; and 1 preserved tree (13-inch diameter at breast height) would be as follows: $[(1,000 \text{ ft}^2) + (20 \text{ shrubs} \times 9 \text{ ft}^2) + (5 \text{ trees} \times 50 \text{ ft}^2) + (100 \text{ ft}^2 \text{ of native ground cover on vegetated roof}) + (1 \text{ preserved tree} \times 600 \text{ ft}^2)] = 2,130 \text{ ft}^2$ entered into the Scoresheet. The native bonus would be $(2,130 \text{ ft}^2) \times (0.1 \text{ multiplier}) = 213 \text{ bonus}$.

PLAN SUBMITTAL

In addition to complying with the standards described below, submitted GAR plans shall provide the native bonus calculations, which identify the species, quantity, and square footage for each native species being credited.

CONSTRUCTION INSPECTION

The Certified Landscape Expert is responsible for reviewing the following construction items for accuracy prior to signing the Landscape Checklist:

- Confirm that all credited plant species are natives or native cultivars per the approved plan.

STANDARDS

DESIGN

Vegetation must meet the following criteria to receive credit:

- The plant species must be listed in the U.S. Fish and Wildlife Service's Native Plants for Wildlife Conservation Landscaping: Chesapeake Bay Watershed Guide. For more information on plant selection visit: <http://nativeplantcenter.net/> or <http://www.nps.gov/plants/pubs/chesapeake/>.
- Alternatively, the applicant may provide 2 references in current publications showing that the plant is native to the region.
- Or, the plant may be a cultivar of one of the native plant species listed above.
- The plant must not be listed on the following lists:
 - U.S. Fish and Wildlife Service's list of Plant Invaders of Mid-Atlantic Natural Areas
 - Mid-Atlantic Exotic Pest Plant Council Plant List (Reported Invasive in DC, MD, VA)
 - National Park Service Center for Urban Ecology – Exotic Plant Management Team
 - Virginia Invasive Plant Species List

CONSTRUCTION

Native plants should comply with the construction standards of the credits to which the bonus is to be applied.

RESOURCES

Heffernan, K., E. Engle, and C. Richardson. 2014. *Virginia Invasive Plant Species List*. Virginia Department of Conservation and Recreation, Division of Natural Heritage. Natural Heritage Technical Document 14-11. Richmond. <http://www.dcr.virginia.gov/natural-heritage/document/nh-invasive-plant-list-2014.pdf>.

National Park Service Center for Urban Ecology. "Exotic Plant Management Team." <https://www.nps.gov/cue/epmt/>.

Slattery, Britt E., Kathryn Reshetiloff, and Susan Zwicker. 2003. *Native Plants for Wildlife Conservation Landscaping: Chesapeake Bay Watershed Guide*. U.S. Fish and Wildlife Service, Chesapeake Bay Field Office, Annapolis, MD. 82pp. <http://www.nps.gov/plants/pubs/chesapeake>.

Swearingen, Jil, Britt Slattery, Kathryn Reshetiloff and Susan Zwicker. 2010. *Plant Invaders Of Mid-Atlantic Natural Areas*, 4th ed. National Park Service and U.S. Fish and Wildlife Service. Washington, DC. 168pp. <http://www.nps.gov/plants/alien/pubs/midatlantic>.

U.S. Fish and Wildlife Service and The Alliance for the Chesapeake Bay. "Chesapeake Bay Native Plant Center." <http://nativeplantcenter.net/>.

5.12 Food Cultivation

Locally grown food enables individuals to reduce travel required for food purchases and provides a healthy and fresh alternative to other food sources. Examples of food cultivation include outdoor community gardens and for-profit and educational food production uses. Sustainable DC food goals include increasing agricultural land uses within the District; cultivating 20 additional acres of land for growing food; ensuring universal access to secure, nutritious and affordable food supplies; ensuring 75% of residents live within 1/4 mile of a community garden, farmers market, or healthy corner store; developing the food industry into a strong and viable economic sector; and producing or obtaining 25% of food within a 100-mile radius. The landscape element “Landscaping in Food Cultivation” provides additional GAR credit above that of credited soil, vegetated wall, and vegetated roof landscape elements.

INTEGRATION

Bonus to the following landscape elements	Soils & Amendments	Bioretention	New & Existing Planting	Tree Preservation	Vegetated Walls	Vegetated Roofs	Permeable Paving	Enhanced Tree Growth	Renewable Energy	Water Features	Native Plants	Food Cultivation	Harvested Stormwater Irrigation
Food Cultivation													

RELATED ADMINISTRATIVE CONSIDERATIONS

District of Columbia Law 20-248, Urban Farming and Food Security Amendment Act of 2014.

SUBMITTAL REQUIREMENTS

CALCULATING THE SCORE

“Landscaping for food cultivation” is a bonus feature; as such, the square footage is measured equivalent to cultivated areas under the items “Landscaped Areas with Soil Depth (of less than 24 inches/of 24 inches or more),” “Vegetated Walls,” and “Vegetated Roofs.”

In addition to the landscape elements listed above, bonus credit is also given to perennial and woody planting.

The cumulative square footage is then computed using the 0.1 multiplier.

GAR Landscape Elements	Multiplier
Food cultivation (Bonus credit)	0.1

For example, the food cultivation bonus for 100 square feet of perennial ground cover and 20 woody shrubs would be as follows: $[(100 \text{ ft}^2) + (20 \text{ shrubs} \times 9 \text{ ft}^2)] = 280 \text{ ft}^2$ entered into the Scoresheet. The food cultivation bonus would be $(280 \text{ ft}^2) \times (0.1 \text{ multiplier}) = 28 \text{ bonus}$.

PLAN SUBMITTAL

In addition to complying with the standards described below, submitted GAR plans shall include the following:

- Location, species, and areas designated for food cultivation
- Identify building access
- Type and location of water source

CONSTRUCTION INSPECTION

The Certified Landscape Expert is responsible for reviewing the following construction items for accuracy prior to signing the Landscape Checklist:

- Confirm the area designated for food cultivation is suitable for crop growth.
- Confirm planting of crops. If work is completed at a time inappropriate for crop growth, stabilize the soil with a cover crop, straw, or similar erosion control method.

STANDARDS

DESIGN

The design must meet the following standards to receive credit:

- Access to food cultivation area must be available to at least one building occupant.
- A water source must be available to all food cultivation plantings.
- Annual, perennial, and woody crops may be credited, including vegetables, grains, herbs, and fruit- and nut-producing trees and shrubs.
- Animal cultivation may not be credited.

CONSTRUCTION

Food cultivation areas should comply with the construction standards of the credits to which the bonus is to be applied.

5.13 Harvested Stormwater Irrigation

Stormwater collected from rooftops or other contributing drainage areas can be directed to storage devices, such as cisterns or rain barrels, and used for landscape irrigation. The landscape element “Harvested Stormwater Irrigation” provides additional GAR credit for landscape areas with soils receiving irrigation from collected stormwater.

INTEGRATION

Bonus to the following landscape elements	Soils & Amendments	Bioretention	New & Existing Planting	Tree Preservation	Vegetated Walls	Vegetated Roofs	Permeable Paving	Enhanced Tree Growth	Renewable Energy	Water Features	Native Plants	Food Cultivation	Harvested Stormwater Irrigation
Harvested Stormwater Irrigation													

RELATED ADMINISTRATIVE CONSIDERATIONS

DOEE Stormwater Management Guidebook, Section 3.3 Rainwater Harvesting.

Refer to the DC Green and Plumbing Construction Codes for additional guidance on designing the water feature landscape element.

SUBMITTAL REQUIREMENTS

CALCULATING THE SCORE

The Harvested Stormwater Irrigation landscape element is a bonus feature; as such, it is measured as additional credit through the square footage of landscape irrigation coverage area. To calculate multiply the coverage area by the 0.1 multiplier.

GAR Landscape Elements	Multiplier
Harvested stormwater irrigation (Bonus credit)	0.1

PLAN SUBMITTAL

In addition to complying with the design standards, submitted GAR plans shall include the following:

- If using spray irrigation, identify treatment standards consistent with the DOEE Stormwater Management Guidebook
- Submit a schematic irrigation and drainage plan showing the following:

- Areas to receive irrigation
- Delivery system (spray, drip)
- Anticipated water demand from plantings that require irrigation
- Water budget indicating percentage of water demand met by rainwater, calculated on a monthly and annual basis
- Drainage plan for all irrigated areas

CONSTRUCTION INSPECTION

The Certified Landscape Expert (CLE) is responsible for ensuring the following construction items meet the standards below prior to signing the Landscape Checklist:

- The effective planting area receiving irrigation from harvested stormwater system is confirmed
- Cistern or rain barrel is appropriately sized for contributing drainage area
- Overflow is sufficiently sized and directed away from building foundation
- Pretreatment system is installed
- Pump is appropriately sized for irrigation tubing diameter and length
- Cistern or rain barrel is accessible for maintenance
- Cistern or rain barrel footing is sufficient to handle the load
- Spray irrigation measures are treated

Refer to the DOEE Stormwater Management Guidebook, Section 3.3 Rainwater Harvesting for additional guidance.

STANDARDS

DESIGN

The CLE will coordinate with qualified professionals in the design and construction of harvested stormwater irrigation systems to ensure the following:

- If the irrigation type is spray, applicants shall follow treatment standards set forth in the DOEE Stormwater Management Guidebook.
- If the irrigation type is drip, no additional treatment of stormwater is required. However, if a stormwater management plan is required, then the applicant must submit a Tiered Risk Assessment Management (TRAM) Proposal.
- Irrigation may be supplied by a combination of harvested rainwater and the public water supply. The percentage of irrigation water demand met by harvested rainwater must be

greater than 50% of annual usage. The default water demand for irrigation is 1.0 inch per week over the area to be irrigated. Justification must be provided if larger volumes are to be used.

- Rainwater harvesting must follow the design criteria defined in the DOEE Stormwater Management Guidebook.
- If a stormwater management plan is required, coordinate with the project engineers to ensure that all stormwater management practices are consistent on all submitted documents.

IRRIGATION DESIGN

- The irrigation specification should include a recommended initial irrigation frequency and time, based upon the season and plant requirements.
- Selection and placement of sprinkler and drip/micro-irrigation components should be guided by the expected size of larger plants. Irrigation zones shall be based on plant water needs with plants of similar need grouped together.
- Place and direct the irrigation heads for minimal overspray or spray onto non-landscape areas.

Delivery of harvested stormwater is accomplished through 2 primary approaches:

Drip Irrigation

Drip irrigation is an appropriate approach for planting beds, living walls, and vegetated roofs. When irrigation lines are subject to photodegradation, protect them from exposure to sunlight.

Spray Irrigation

Spray irrigation requires water quality treatment in accordance with the DOEE Stormwater Management Guidebook.

CISTERN DESIGN

Cisterns and rain barrels are cost-effective and environmentally friendly measures to supply water to vegetated areas. Harvesting stormwater for irrigation helps to reduce the peak hydrograph, restore natural hydrology, and save money on water bills. Harvested stormwater can be applied to vegetated areas via drip or spray and can be gravity-fed or pumped. Choosing the right cistern or rain barrel and pump will depend on a variety of factors.

Cistern size and location, contributing drainage area, placement, footing, filters, associated plumbing and pumps must comply with the DOEE Stormwater Management Guidebook, Section 3.3 Rainwater Harvesting, and be designed by a qualified professional. The CLE will work in coordination with qualified professionals to determine planting areas requiring harvested stormwater irrigation and associated irrigation water demand.

Cistern Size

The volume of the water captured will depend on the size of the impervious contributing drainage area and the size of the cistern, which should be balanced against the water demand of the irrigated lands. Calculate the watering rate (output) needed based on the plant species present.

Cistern or Rain Barrel Location

The cistern or rain barrel should be located in close proximity to the vegetated areas where the water will be applied. Above-ground cisterns are less expensive to install because they do not require excavation. Above-ground cisterns need to be taken offline in the winter months to avoid freeze/thaw. Cisterns larger than 5,000 gallons will need a structural design to account for wind and load. Below-ground systems save valuable land space, but require excavation, thus increasing installation costs. Most commercial projects utilize below-ground systems.

Pump Type and Placement

If the irrigated areas are not at a 10% negative slope from the cistern or rain barrel, a pump is recommended. Pumps can be submersible or in-line, suction pumps. Submersible pumps are placed directly in the cistern. The cistern pump should be hardwired to the power source. Suction or in-line pumps are placed above ground, but are limited by depth and pressure. A low-pressure transfer suction pump can be connected to the cistern with an additional pressure booster pump.

Filters or Sediment Traps

A fine mesh filter or sediment trap must be used to capture fine particulate matter such as debris from asphalt shingles, leaf litter, or twigs.

Cistern or Rain Barrel Material

Cisterns or rain barrels can be made of materials such as polyethylene, plastic, concrete, steel-reinforced polyethylene, and fiberglass.

Water Demand for Landscaping - (CLE coordinates with qualified professionals.)

The design plan elements must include the proposed delineation of planting areas to be irrigated, the planting plan, and quantification of the expected water demand. The default water demand for irrigation is 1.0 inch per week over the area to be irrigated. Justification must be provided if alternative volumes are to be used. Irrigation may be supplied by a combination of harvested rainwater and the public water supply. The percentage of irrigation water demand met by harvested rainwater must be greater than 50% of annual usage. In collaboration with the design engineer, refer to the Rainwater Harvesting Retention Calculator, <http://doee.dc.gov/node/610622>, for guidance in identifying the percent demand met by harvested rainwater.

CONSTRUCTION

Follow the Rainwater Harvesting Construction Sequence guidelines outlined in the DOEE Stormwater Management Guidebook, Section 3.3.6.

REFERENCES

Baum-Haley, Melissa, editor. 2014. *Landscape Irrigation Best Management Practices*. Irrigation Association and American Society of Irrigation Consultants.

District of Columbia Department of Energy and Environment. 2013. "Rainwater Harvesting." In *DOEE Stormwater Management Guidebook*. 43-65. Washington, DC.

RESOURCES

District of Columbia Department of Energy and Environment. "Rainwater Harvesting Retention Calculator," <http://doee.dc.gov/node/610622>.

United States Environmental Protection Agency. "WaterSense: Water Budget Data Finder," last modified March 24, 2017. <https://www.epa.gov/watersense/water-budget-data-finder>.

Chapter 6

Landscape Maintenance Plan

The landscape maintenance plan serves as guidance for the property owner to properly maintain the landscape elements installed under the Green Area Ratio (GAR). When suitable, coordinate submission of GAR landscape maintenance plans with those required under the District of Columbia's stormwater management regulations.

SUBMITTAL REQUIREMENTS

The landscape maintenance plan must be prepared and signed by the Certified Landscape Expert (CLE). The plan is submitted within the plan set, as part of the building permit application. The plan describes how to properly maintain all components of the approved GAR landscape elements. Provide any manufacturer-specific maintenance guidelines, if applicable.

A GAR landscape maintenance plan should address maintenance activities and schedules for each landscape element. The plan should address but not be limited to the following subject areas:

- Soil preparation
- Use of compost
- Plant replacement
- Irrigation
- Weed and pest control
- Control of noxious or invasive species
- Water features
- Hardscape features

PROPERTY OWNER RESPONSIBILITY

The landscape maintenance plan must be issued to the property owner prior to the CLE completing the Landscape Checklist. This plan serves as guidance for the property owner to ensure all GAR-related features are maintained. The property owner and all subsequent owners are obliged to maintain the GAR score at or above the minimum level set in the regulations. Should the GAR score fall below the minimum required, other GAR environmental performance features can be substituted to achieve an appropriate score. This process does not require plan resubmittal.

ANACOSTIA WATERSHED DEVELOPMENT ZONE

GAR sites within the Anacostia Waterfront Development Zone require landscape maintenance plans consistent with the Integrated Pest Management Plan. Refer to the DOEE Stormwater Management Guidebook, Appendix R Integrated Pest Management, for additional guidance.

LANDSCAPE MAINTENANCE PLAN GUIDELINES

Recommended maintenance activities are listed for each landscape element. Maintenance activities should be performed by a qualified individual. The maintenance professional should exercise proper judgment in regards to personal safety.

SOILS AND AMENDMENTS

Soil maintenance plans should provide guidance for the soil amendment application rate, schedule of work, and material source.

Decompaction

- Decompact topsoil by tilling or subsoiling and incorporating compost throughout the depth of compacted soil. Do not till soils underneath existing trees; instead consider practices such as mulching under the canopy or air tilling to ameliorate compaction.

Rate and application schedule

- Mulch – Apply yearly or as necessary to replace decomposed mulch.
- Compost – Apply compost yearly at a depth of 1–2 inches. Coarse-textured sand and clay soils require greater compost addition than loamy soils. The organic matter content of the chosen compost will influence the application depth.
- Fertilizer – Apply fertilizer only after incorporating compost into topsoil and conducting a soil test. This will avoid over-application of nutrients, as compost itself will increase the nutrient content.

Material source

- Compost should be well-decomposed material; stable; and free of weeds, contaminants, and foul odors. Compost may be derived from yard waste (decomposed leaves, grass clippings, branches) or food waste.
- Mulch can be derived from organic sources such as shredded bark or leaves.

BIORETENTION

Maintenance criteria for bioretention can be found in the DOEE Stormwater Management Guidebook, Section 3.6.7.

Table 8 Bioretention Maintenance Tasks (Source: DOEE Stormwater Management Guidebook, Table 3.23)

Frequency	Maintenance Tasks
Upon establishment	<ul style="list-style-type: none"> For the first 6 months following construction, the practice and contributing drainage area (CDA) should be inspected at least twice after storm events that exceed 1/2 inch of rainfall. Conduct any needed repairs or stabilization. Inspectors should look for bare or eroding areas in the CDA or around the bioretention area and make sure they are stabilized immediately with grass cover. One-time spot fertilization may be needed for initial plantings. Watering is needed once per week during the first 2 months and then as needed during the first growing season (April–October), depending on rainfall. Remove and replace dead plants. Up to 10% of the plant stock may die off in the first year, so construction contracts should include a care and replacement warranty to ensure vegetation is properly established and survives during the first growing season following construction.
At least 4 times per year	<ul style="list-style-type: none"> Mow grass filter strips and bioretention with turf cover. Check curb cuts and inlets for accumulated grit, leaves, and debris that may block inflow.
Twice during growing season	<ul style="list-style-type: none"> Spot weed, remove trash, and rake the mulch.
Annually	<ul style="list-style-type: none"> Conduct a maintenance inspection. Supplement mulch in devoid areas to maintain a 3-inch layer. Prune trees and shrubs. Remove sediment in pretreatment cells and inflow points.
Once every 2–3 years	<ul style="list-style-type: none"> Remove sediment in pretreatment cells and inflow points. Remove and replace the mulch layer.
As needed	<ul style="list-style-type: none"> Add reinforcement planting to maintain desired vegetation density. Remove invasive plants using recommended control methods. Remove any dead or diseased plants. Stabilize the CDA to prevent erosion.

NEW AND EXISTING PLANTINGS

All Plantings

- Provide supplemental watering if rainfall is less than 1 inch per week during the first 2 growing seasons.
- Conduct weeding as necessary to reduce competition between weeds and plantings for nutrients, soil moisture, and sunlight.
- Replace mulch every 2–3 years, or as necessary to recommended depth (see the following paragraphs).
- Monitor the plantings for disease or stress and modify maintenance practices as necessary. Employ an integrated pest management (IPM) approach if possible.
- Remove dead plant material and replant in the next appropriate growing season.

Trees and Shrubs

- For trees, install slow-leak watering bags or tree buckets during the first 2 growing seasons. Water as necessary to supplement precipitation if less than 1 inch per week. Remove watering bags or tree buckets after plants have established.
- Inspect trees for signs of dead, diseased, or crossing branches and prune accordingly. Remove hazard limbs from established trees. Never remove more than 20% of the tree canopy during pruning activities in any year.
- Spread mulch at a maximum 3-inch depth and ensure mulch is not against the trunk of the tree.
- Maintain tree health by limiting all grade changes and other soil disturbance underneath the tree's critical root zone.

Perennials and Ground Covers

- In the early spring, deadhead top-growth from perennials and warm-season grasses.
- Periodically divide perennials as necessary to encourage rejuvenated growth.
- Spread mulch at a maximum 2-inch depth.

Turf Grass

- Apply lime and fertilizer only as soil test results indicate.
- To reduce weed germination, maintain turf grass at an increased height. Never mow more than 1/3 of the grass height. Maintaining grass clippings in place after mowing reduces fertilizer requirements.
- Regularly monitor and over-seed bare spots to prevent weed establishment.
- In late fall, core aerate and top-dress with organic matter.

TREE MAINTENANCE

- The property owner must replace dead trees with an equivalent landscape element to meet the minimum required GAR score for the site.
- Where appropriate, spread 3 inches of organic mulch over the soil surface out to the dripline of the preserved tree. If preserved trees are clustered, mulch the entire planting area. Mulch should never be more than 4 inches deep or applied to the tree trunk.
- Apply slow-decomposing organic mulches, such as shredded bark, compost, leaf mulch, or wood chips. Grass clippings and sawdust are not recommended as mulches because they decompose rapidly.
- As needed, prune dead, diseased, broken, or crossing branches. Elevate lower branches to provide clearance for pedestrian and vehicular activity below. Never prune more than 20% of a tree canopy per year.
- Existing trees whose roots have been pruned during construction should be watered at least once per week during the first growing season after construction.
- Water trees deeply and slowly to encourage deeper root growth. Soaker hoses and drip irrigation work best for deep watering of trees.
- Consult with a qualified professional for tree pruning, fertilization, and hazard condition management.

VEGETATED WALLS

Many vegetated walls are proprietary systems constructed and maintained by a company for a defined contract period. The following are general guidelines for maintaining vegetated walls:

Living Facades

- Periodically inspect roof gutters and drains for clogging with vegetation or debris.
- Cable systems may require retensioning or inspection of the integrity of wall tie-ins.
- Schedule regular plant maintenance during establishment and ongoing growth. Inspect the plants for signs of disease, weed competition, training along the support structure, and pruning needs.

Living Walls

- Individual vegetated panels from living walls should be removed to inspect the wall and support structures for drainage and anchorage issues. Clean all drains and gutters yearly.
- When using harvested stormwater irrigation, valves and fertilizer injectors should be checked for function and the irrigation pipes checked for leaks. Schedule frequent irrigation inspections. Drip irrigation emitters should be checked during operation to ensure water is being delivered to all panels. Winterize irrigation systems per the irrigation specification.

- Schedule regular plant maintenance during establishment and ongoing growth. Inspect the vegetated wall for signs of disease, inadequate irrigation, and erosion.

VEGETATED ROOFS

Maintenance criteria for green roofs can be found in the DOEE Stormwater Management Guidebook, Section 3.2.7. A vegetated roof should be inspected by a qualified professional twice per year during the growing season to assess vegetative cover and to look for leaks, drainage problems, and any rooftop structural concerns (see Table 9).

Drainage and Waterproofing Systems

- If a roof leak is suspected, it is advisable to perform an electric leak survey (e.g., Electronic Field Vector Mapping), if applicable, to pinpoint the exact location, make localized repairs, and then reestablish system components and ground cover.
- Inspect drainage structures for blockage or signs of loss of soil.

Soil and Vegetation

- The vegetated roof should be hand weeded to remove invasive or volunteer plants, and plants and/or growing media should be added to repair bare areas.
- The use of herbicides, insecticides, and fungicides should be avoided since their presence could hasten degradation of some waterproofing membranes. Check with the membrane manufacturer for approval and warranty information.
- Irrigation of vegetated roofs is typically required for larger plant material and non-succulents. Extensive roofs with succulent species do not require permanent irrigation but should have access to irrigation as needed, through hose bibs or other sources.
- Power washing and other exterior maintenance operations should be avoided so that cleaning agents and other chemicals do not harm the vegetated roof plant communities.
- Fertilization is generally not recommended due to the potential for leaching of nutrients from the vegetated roof. Supplemental fertilization may be required following the first growing season, but only if plants show signs of nutrient deficiencies and a growing media test indicates a specific deficiency. Addressing this issue with the holder of the vegetation warranty is recommended. If fertilizer is to be applied, it must be a slow-release type, rather than liquid or gaseous form.
- A vegetated roof should be inspected by a qualified professional twice per year during the growing season to assess vegetative cover and to look for leaks, drainage problems, and any rooftop structural concerns (see Table 9). In addition, the vegetated roof should be hand weeded to remove invasive plants or tree seedlings. Plants and/or growing media should be added to repair bare areas (refer to ASTM E2400 (ASTM, 2006)). Established vegetated roof vegetation should provide year-round soil stabilization, minimal weed coverage, and drought tolerance appropriate to the available soil depth and irrigation. Volunteer species

such as perennial grasses, forbs, and mosses are desirable if they do not compromise the long-term stability and performance of the vegetated roof as described above. Excessive and dead biomass should be removed at a minimum of 2 times per year.

- Comply with the manufacturer’s maintenance guidelines, if provided.

Forms for DOEE’s “Green Roof Maintenance Inspection Report” and the “Maintenance Service Completion Inspection Report” can be found in the DOEE Stormwater Management Guidebook, Appendix L.

Table 9 Typical Maintenance Activities Associated with Vegetated Roofs

Schedule Following Construction	Activity
As needed or as required by manufacturer	<ul style="list-style-type: none"> • Water to promote plant growth and survival. • Inspect the vegetated roof and replace any dead or dying vegetation.
Semi-annually	<ul style="list-style-type: none"> • Inspect the waterproof membrane for leaks and cracks. • Weed to remove invasive plants and tree seedlings (do not dig or use pointed tools where there is potential to harm the root barrier or waterproof membrane). • Inspect roof drains, scuppers, and gutters to ensure they are not overgrown and have not accumulated organic matter deposits. Remove any accumulated organic matter or debris. • Inspect the vegetated roof for dead, dying, or invasive vegetation. Plant replacement vegetation as needed.

PERMEABLE PAVING

Maintenance is critical to the performance and longevity of permeable paving systems. Clogging of paving systems with sediment and organic material is the most frequently cited maintenance item. Regular street sweeping and inspection of the paving system is required to remove accumulated sediment and to provide maintenance repairs as needed to help prevent clogging. It is critical that surrounding areas remain stabilized and do not introduce sediment onto the permeable paving. Maintenance criteria for permeable paving can be found in the DOEE Stormwater Management Guidebook, Section 3.5.7. Follow the manufacturer’s maintenance guidelines, if available.

Table 10 Typical Maintenance Tasks for Permeable Paving Practices

Frequency	Maintenance Task
After installation	For the first 6 months following construction, the practice and CDA should be inspected at least twice per week after storm events that exceed 1/2 inch of rainfall. Stabilize any failing areas that may be depositing sediment onto the pavement areas.
Once every 1–2 months during the growing season	Mow the grass in a vegetated permeable pavement application.
As needed	Stabilize the CDA to prevent erosion. Remove any soil or sediment deposit on the pavement. Replace or repair any pavement surfaces that are degenerating or spalling .
2–4 times per year	Mechanically sweep pavement with a standard street sweeper.
Annually	Conduct a maintenance inspection. Spot weed for grass applications.
Once every 2–3 Years	Remove any accumulated sediment in pretreatment areas and inflow areas.
If clogged	Conduct maintenance using a regenerative street sweeper or vacuum sweeper. Replace any joint materials.

ENHANCED TREE GROWTH

Periodically perform the following maintenance activities:

- Inspect pavement for settling or heaving and correct as necessary.
- Inspect and clear irrigation and drainage components, if present.
- Comply with the manufacturer’s maintenance guidelines.

RENEWABLE ENERGY

Solar photovoltaic and solar thermal systems require periodic inspections and routine maintenance to keep them operating efficiently. Also, from time to time, components may need repair or replacement. System owners should also take steps to prevent scaling, corrosion, and freezing with solar thermal systems.

Property owners might be able to handle some of the inspections and maintenance tasks on their own, but more complicated systems and equipment may require a qualified technician. Ask for a cost estimate in writing before having any work done. For some systems, it may be more cost effective to replace, shut off, or remove the solar system than to have it repaired. Refer to the manufacturer-provided owner’s manual for additional guidance.

Periodic Inspection List

The following are suggested inspections of solar photovoltaic and solar thermal components:

- Collector shading
- Collector soiling
- Collector glazing and seals
- Plumbing, ductwork, and wiring connections
- Piping, duct, and wiring insulation
- Roof penetrations
- Support structures
- Pressure relief valves (on liquid solar heating collectors)
- Dampers (in solar air heating systems)
- Pumps or blowers
- Heat transfer fluids
- Storage systems
- Review of emergency and safety components
- Compliance with the manufacturer's maintenance guidelines, if provided

WATER FEATURES

Water feature devices should be maintained by a qualified professional. Refer to the manufacturer's product guidance materials for maintenance instructions. Comply with all DC Codes for water quality treatment. Maintenance criteria for rainwater harvesting for water features can be found in the DOEE Stormwater Management Guidebook, Section 3.3.7.

- Comply with DC codes and refer to materials supplied by product manufacturer for maintenance guidance.
- Take measures to protect all piping and storage tanks from freezing.
- Periodically clean and maintain all filtration devices.
- Repair all erosion or other sources of contamination in the harvested stormwater contributing drainage area.

FOOD CULTIVATION

The property owner is required to maintain areas credited under "Landscaping for Food Cultivation" yearly, in accordance with seasonal restrictions. Should a property owner not wish

to continue growing food crops, they must ensure that the minimum GAR scored is achieved otherwise.

The recommended maintenance schedule for food cultivation crops includes the following:

Spring

- Till the cover crop or remove straw mulch to prepare for planting of crops.
- Incorporate organic matter and fertilize as soil tests deem necessary.
- Plant cool-weather crops.
- Apply mulch to non-planted areas to retain moisture and reduce weed pressure.

Summer

- Harvest cool season crops.
- Plant warm season crops early in the season.
- Employ an integrated pest management strategy to control garden pests and diseases.
- Periodically weed and irrigate as needed.

Fall

- Place a winter cover crop or mulch over the exposed soil.

HARVESTED STORMWATER IRRIGATION

Harvested stormwater irrigation devices should be maintained by a qualified professional. Maintenance criteria for rainwater harvesting can be found in the DOEE Stormwater Management Guidebook, Section 3.3.7. Refer to the product manufacturer's guidance materials for additional maintenance instruction.

Cistern

- The cistern must be cleaned yearly. Follow manufacturer specifications when cleaning.
- The purpose of the maintenance is to remove the sediment that inevitably deposits on the cistern's floor and may give rise to parasitic fermentation and odor. The rate at which the sediment accumulates depends on the region's atmospheric pollution (for dust), the roof type, and the quality of the set-up upstream from the cistern storage compartment.
- A fine mesh filter placed between the roof gutter's main downspout and the sedimentation basin will substantially delay the accumulation of sediment in the barrel or cistern. Additionally, a sedimentation basin equipped with an appropriate trapped overflow that prevents the passage of floating impurities may be used. Filters need to be cleaned monthly.

- Cisterns and rain barrels should be dewatered often to ensure available volume for the onset of rain events.

Irrigation

- Conduct frequent inspections to verify the integrity of the irrigation system.
- Periodically review the pressure regulators, filters, controller, sensors, valves, sprinkler heads, and other system components to verify they meet original design criteria for efficient operation and uniform water distribution.
- Ensure that replacement hardware used for system repairs matches the existing hardware and is in accordance with the design. Ensure that system modifications are in keeping with design specifications and do not cause water demand to exceed the system's hydraulic capacity.
- Winterize irrigation systems and reestablish operation in the spring.

Appendix A Forms

This appendix includes figures of the following forms:

- Green Area Ratio Worksheet
- Green Area Ratio Scoresheet
- Green Area Ratio Landscape Checklist
- Application for Exemption Status
- Application for Transition Exemption Status

These forms are available electronically at <https://doee.dc.gov/GAR>.

GREEN AREA RATIO Worksheet*								★ ★ ★ =====
		Quantity of GAR Features per Submitted Sheet						TOTAL**
		Sheet #	Sheet #	Sheet #	keep adding columns as needed			
A1	square feet							0
A2	square feet							0
A3	square feet							0
B1	square feet							0
B2	# of plants							0
B3	# of trees							0
B4	# of trees							0
B5	# of trees							0
B6	# of trees							0
B7	# of trees							0
B8	# of trees							0
B9	square feet							0
C1	square feet							0
C2	square feet							0
D1	square feet							0
D2	square feet							0
E1	square feet							0
E2	square feet							0
E3	square feet							0
F1	square feet							0
F2	square feet							0
F3	square feet							0

* See Green Area Ratio Scoresheet for category definitions

** Enter totals on the Green Area Ratio Scoresheet

Green Area Ratio Scoresheet					
<div style="display: flex; align-items: center;"> <div style="width: 20px; height: 20px; background-color: red; margin-right: 5px;"></div> <div style="width: 20px; height: 20px; background-color: red; margin-right: 5px;"></div> <div style="width: 20px; height: 20px; background-color: red; margin-right: 5px;"></div> <div style="margin-left: 5px;">Address <input style="width: 150px;" type="text"/></div> </div>		Square	Lot	Zone District	
<div style="display: flex; align-items: center;"> <div style="width: 20px; height: 20px; background-color: red; margin-right: 5px;"></div> <div style="margin-left: 5px;">Other <input style="width: 150px;" type="text"/></div> </div>		Lot area (sf)	Minimum Score	Multiplier	GAR Score
<div style="color: red; font-size: small;">Lot size (enter this value first) *</div> <input style="width: 100px;" type="text"/>			SCORE: #DIV/0!		
Landscape Elements		Square Feet	Factor	Total	
A Landscaped areas (select one of the following for each area)					
1	Landscaped areas with a soil depth < 24"	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	0.30	-	
2	Landscaped areas with a soil depth ≥ 24"	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	0.60	-	
3	Bioretention facilities	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	0.40	-	
B Plantings (credit for plants in landscaped areas from Section A)					
1	Groundcovers, or other plants < 2' height	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	0.20	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	-
2	Plants ≥ 2' height at maturity - calculated at 9-sf per plant	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;"># of plants</div>	0.30	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;"># of plants</div>	-
3	New trees with less than 40-foot canopy spread - calculated at 50 sq ft per tree	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;"># of trees</div>	0.50	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;"># of trees</div>	-
4	New trees with 40-foot or greater canopy spread - calculated at 250 sq ft per tree	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;"># of trees</div>	0.60	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;"># of trees</div>	-
5	Preservation of existing tree 6" to 12" DBH - calculated at 250 sq ft per tree	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;"># of trees</div>	0.70	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;"># of trees</div>	-
6	Preservation of existing tree 12" to 18" DBH - calculated at 600 sq ft per tree	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;"># of trees</div>	0.70	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;"># of trees</div>	-
7	Preservation of existing trees 18" to 24" DBH - calculated at 1300 sq ft per tree	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;"># of trees</div>	0.70	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;"># of trees</div>	-
8	Preservation of existing trees 24" DBH or greater - calculated at 2000 sq ft per tree	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;"># of trees</div>	0.80	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;"># of trees</div>	-
9	Vegetated wall, plantings on a vertical surface	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	0.60	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	-
C Vegetated or "green" roofs					
1	Over at least 2" and less than 8" of growth medium	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	0.60	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	-
2	Over at least 8" of growth medium	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	0.80	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	-
D Permeable Paving***					
1	Permeable paving over 6" to 24" of soil or gravel	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	0.40	-	
2	Permeable paving over at least 24" of soil or gravel	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	0.50	-	
E Other					
1	Enhanced tree growth systems***	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	0.40	-	
2	Renewable energy generation	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	0.50	-	
3	Approved water features	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	0.20	-	
<i>sub-total of sq ft =</i>		0			
F Bonuses					
1	Native plant species	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	0.10	-	
2	Landscaping in food cultivation	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	0.10	-	
3	Harvested stormwater irrigation	<div style="border: 1px solid black; width: 50px; height: 20px; margin: 0 auto; text-align: center; font-size: x-small;">square feet</div>	0.10	-	
<i>Green Area Ratio numerator =</i>		-			
*** Permeable paving and structural soil together may not qualify for more than one third of the Green Area Ratio score.					
Total square footage of all permeable paving and enhanced tree growth.					



**GOVERNMENT OF THE DISTRICT OF COLUMBIA
DEPARTMENT OF ENERGY & ENVIRONMENT
WATERSHED PROTECTION DIVISION/INSPECTION & ENFORCEMENT BRANCH
Green Area Ratio - Landscape Checklist**

I, _____, declare as follows:
Full Name of Certified Landscape Expert (Printed)

☐ I am a Certified Landscape Expert, as defined in DCMR Title 11, Chapter 34, responsible for confirming installation of the approved landscape plan for development located at:

_____, Washington, DC, and developed pursuant to:
Street Address (Printed)

Building Permit Number DOEE Plan Number

Lot Square

☐ The landscape elements shown on the DOEE-approved landscape plan or DOEE-approved modification for this property have been installed as approved and in a manner consistent with the standards of 11 DCMR Chapter 34. This includes the number size, and approximate location of plantings and other approved landscape elements.

☐ Any changes or species substitutions (if applicable) have been approved by DOEE.

☐ A completed Landscape Maintenance Plan has been submitted to the property owner.

I declare under penalty of perjury under the laws of the District of Columbia that the following is true and correct.

Signature of Certified Landscape Expert Certification/Registration Number Date

NOTE: If any landscape elements have been changed during installation, DO NOT SIGN OR SUBMIT this checklist until a revised landscape plan has been approved by the Department of Energy & Environment. If you provide false information in this document, you may be subject to criminal or civil liability.

[TO BE COMPLETED BY DOEE INSPECTOR]

The DOEE inspector signature indicates the present condition of credited GAR landscape elements to be in compliance with the GAR approved plan. The DOEE inspection reflects the condition of components that are accessible, observable, or otherwise documented by the inspector.

Document received by: _____
Inspector Signature Printed Name Badge No. Date

**GOVERNMENT OF THE DISTRICT OF COLUMBIA
DEPARTMENT OF CONSUMER REGULATORY AFFAIRS**



**APPLICATION FOR EXEMPTION STATUS
FROM D.C. ZONING REGULATION GREEN AREA RATIO**

[APPLICANT TO FILL OUT]

I hereby request evidence of exemption from the Green Area Ratio (GAR) Subtitle C Chapter 6 of DCMR Title 11 for the proposed construction on the property identified below.

Address: _____

Square: _____ **Lot:** _____ **Building Permit Number:** _____

Allowable Exemptions (CHECK ONE):		Required Signatures
<input type="checkbox"/>	Single dwelling unit (Subtitle A §302.2); buildings otherwise not requiring a certificate of occupancy (Subtitle C §601.3).	OZA
<input type="checkbox"/>	Any property within a R-, RF-, USN, STE, HE, WR-1, and WR-6 Districts (Subtitle C §601.2).	OZA
<input type="checkbox"/>	Municipal wastewater treatment facilities operated by DC Water and Sewer Authority (Subtitle C §601.3(b)).	DCWater and OZA
<input type="checkbox"/>	Building(s) or structure(s) certified by the DC Inventory of Historic Sites, or State Historic Preservation Officer, as "historic resource(s)"; additions increase the gross floor area by less than 50 percent (Subtitle C §601.3(d), §601.7).	Historic and OZA
<input type="checkbox"/>	Additions, interior renovations, or both are less than 100 percent of the assessed building value as set forth in the records of the Office of Tax and Revenue as of the date of the building permit application (Subtitle C §601.3).	OZA
<input type="checkbox"/>	Interior Renovations: (a) Central Employment Area, (b) 100 percent lot occupancy, (c) existing roof not capable of supporting vegetated system, and (d) proposed work does not result in a roof capable of supporting vegetated roof. (Note: all four conditions are required for this exemption), (Subtitle C §601.3).	Structural and OZA

Applicant Name: _____ **Address:** _____

Signature: _____ **Date:** _____ **Phone:** _____

[FOR DCRA USE ONLY]

DCRA STRUCTURAL

☐
☐

I find there is sufficient evidence the existing roof for the property is NOT capable of supporting a vegetated system.
I find there is sufficient evidence the proposed work will NOT result in a roof capable of supporting a vegetated system.

This review does not constitute an interpretation of zoning or building codes and does not entitle the applicant to any relief not authorized by zoning or building code officials pursuant to the applicable codes.

Signature: _____ **Printed Name:** _____ **Date:** _____

STATE HISTORIC PRESERVATION OFFICER

I hereby certify that this property is either a historic landmark or a building or structure contributing to the character of a historic district listed in the D.C. Inventory of Historic Sites. *This certification does not constitute an interpretation of zoning or building codes and does not entitle the applicant to any relief not authorized by zoning or building code officials pursuant to the applicable codes.*

Signature: _____ **Printed Name:** _____ **Date:** _____

OFFICE OF ZONING ADMINISTRATOR ONLY [Exemption Categories—Subtitle C §601]

☐
☐
☐
☐
☐

Single dwelling unit or buildings otherwise not requiring a certificate of occupancy
R and RF zoning district
Municipal wastewater treatment facilities operated by DC WASA
Central Employment Area zoning district
Additions will NOT result in an increase to the gross floor area by more than 50 percent (Historic Site)
Additions, and/or interior renovations will NOT exceed 100 percent of the assessed building value

Signature: _____ **Printed Name:** _____ **Date:** _____

DC WATER AND SEWER AUTHORITY OFFICER

I hereby certify that this property is a municipal wastewater treatment facility operated by DC Water & Sewer Authority. *This certification does not constitute an interpretation of zoning or building codes and does not entitle the applicant to any relief not authorized by zoning or building code officials pursuant to the applicable codes.*

Signature: _____ **Printed Name:** _____ **Date:** _____

DCRA, 1100 4th Street, SW, Suite E650 Washington, DC 20024 phone 202-442-4400 fax 202-442-9445

GOVERNMENT OF THE DISTRICT OF COLUMBIA
DEPARTMENT OF CONSUMER REGULATORY AFFAIRS



**APPLICATION FOR EXEMPTION STATUS
FROM D.C. ZONING REGULATION GREEN AREA RATIO
BASED ON TRANSITION PERIOD FILING STATUS**

I hereby request evidence of a transition period exemption from the Green Area Ratio (GAR) Subtitle C, Chapter 6 of DCMR Title 11 for the proposed construction on the property identified below.

Address: _____

Square: _____ Lot: _____ Building Permit Number: _____

Allowable Transition Period Exemptions (CHECK ONE):

<input type="checkbox"/>	Building Permit filed prior to October 1 st , 2013.
<input type="checkbox"/>	Unexpired approval of a first stage, second stage, or consolidated planned unit development (PUD) when vote to approve occurred before October 1 st , 2013.
<input type="checkbox"/>	Unexpired approval of a variance, special exception, design review under the CG or SEFC overlay when vote to approve occurred before October 1 st , 2013.
<input type="checkbox"/>	Unexpired approval of a concept design by the Historic Preservation Review Board or Commission of Fine Arts when vote to approve occurred before October 1 st , 2013.
<input type="checkbox"/>	Unexpired approval of a variance, special exception, design review under the CG or SEFC overlay when a public hearing occurred before October 1 st , 2013.
<input type="checkbox"/>	Unexpired approval of a first stage, second stage, or consolidated planned unit development (PUD) when public hearing occurred before October 1 st , 2013.

NOTE: When impervious surface or lot occupancy is increased by 20 percent or more, that increase is not covered under this exemption. The GAR is applied to the modification.

Applicant _____ Telephone _____

Address _____

Signature _____ Date _____


ZONING OFFICE USE ONLY

- ☐ Building Permit submitted prior 10/01/2013.
☐ PUD vote prior 10/01/2013.
☐ PUD with public hearing prior 10/01/2013.
☐ Variance, special exception, or design review under the CG or SEFC overlay vote prior 10/01/2013.
☐ Variance, special exception, or design review under the CG or SEFC public hearing prior 10/01/2013.
☐ Historic Preservation Review Board or Commission of Fine Arts vote prior 10/01/2013.

Office of Zoning Administrator _____ Date _____

Appendix B

Map of Central Employment Area

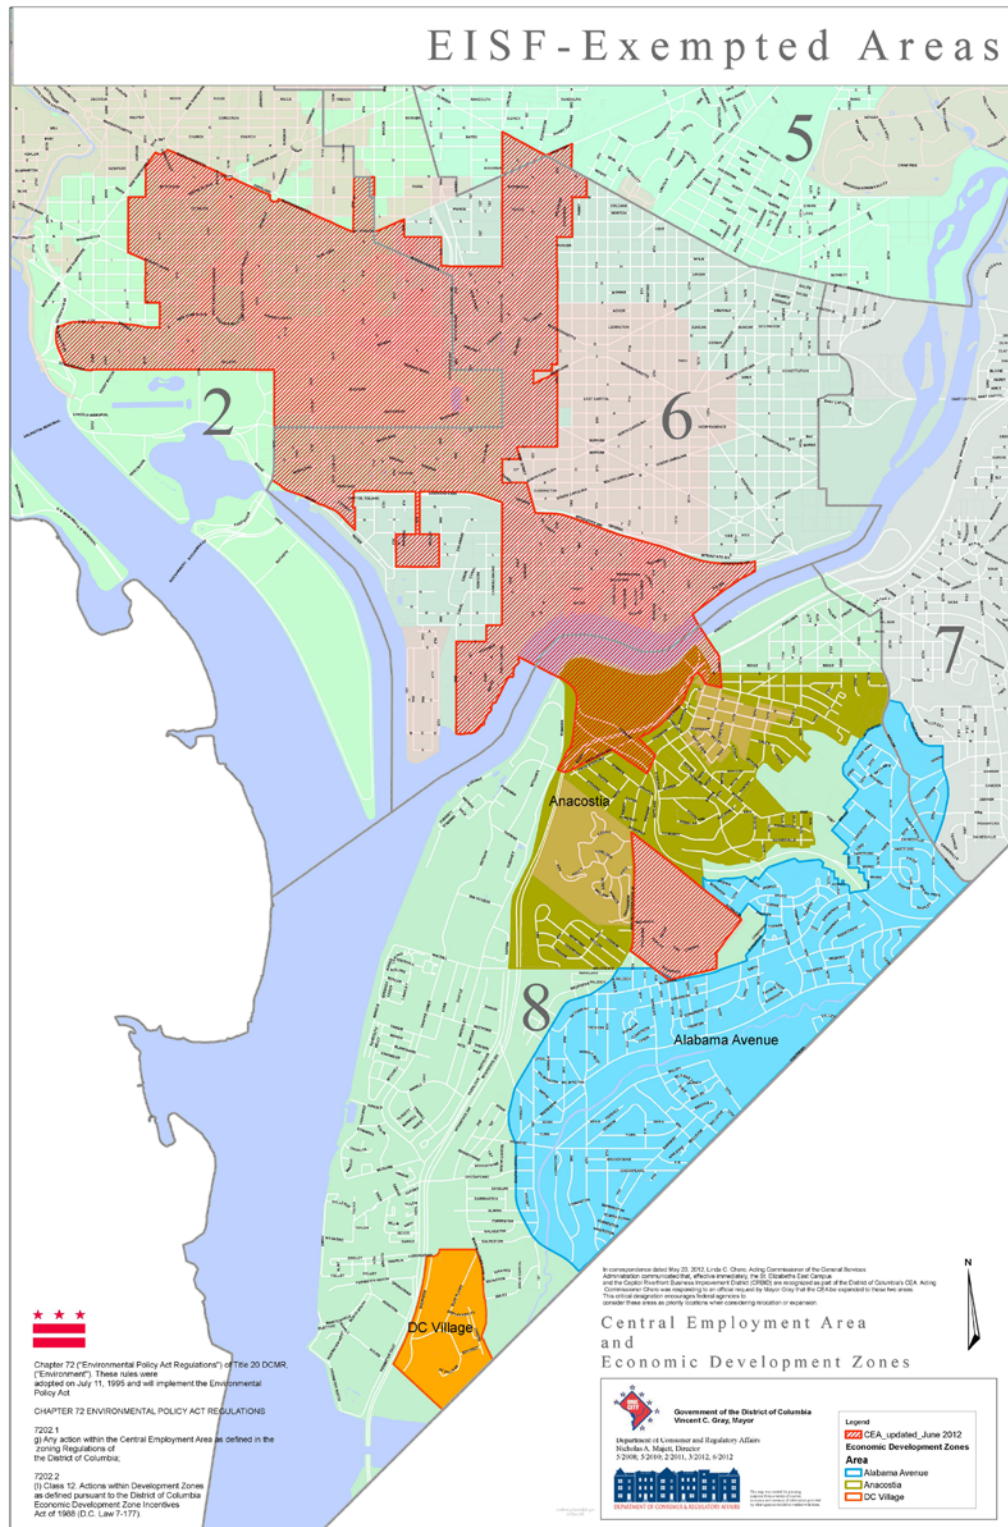

Applicant – The person or their agent who applies for the building permit and Certificate of Occupancy.

Building permit – Authorization for construction activity issued by the District of Columbia Department of Consumer and Regulatory Affairs.

Caliper – Measurement standard for new trees according to the American Nursery and Landscape Association American Standards for Nursery Stock.

Canopy radius – The distance from the tree trunk to its dripline.

Central Employment Area – For defined areas, refer to Appendix B or this link:
https://dcra.dc.gov/sites/default/files/dc/sites/dcra/publication/attachments/eisf_fsize2012june.pdf.

Certificate of Occupancy – Granted by the Office of Zoning Administrator at the Department of Consumer and Regulatory Affairs after ensuring the use of building, structure, or land in the District of Columbia conforms to the Zoning Regulations (11 DCMR) and the provisions of the DC Building Code (12 DCMR).

Certified Landscape Expert (CLE) – Professionals (defined under 11 DCMR Subtitle C § 604.2) qualified to review and sign GAR plans and Landscape Checklist for conformance with GAR requirements.

Compaction – Compression and loss of pore space in soil resulting in conditions unsuitable to root growth. This is measured by increased soil resistance to a penetrometer or increased bulk density.

Critical Root Zone (CRZ) – The minimum protection area required to preserve the health and stability of a tree during construction. It is measured as a circular area with a radius (in feet) equal to 1.5 times the trunk diameter (in inches).

Diameter at Breast Height (DBH) – Measurement standard for existing trees at 4-feet 6-inches above grade.

Dripline – Extent of the tree canopy.

Element – See “Landscape Element.”

Historic resource – A building or structure listed in the District of Columbia Inventory of Historic Sites or a building or structure certified in writing by the State Historic Preservation Officer as contributing to the character of the historic district in which it is located.

Impervious surface – A surface area that has been compacted or covered with a layer of material that impedes or prevents the infiltration of water into the ground. See definition of “impervious cover” in the District of Columbia stormwater management regulations.

Landscape Checklist – The document to be signed by the Certified Landscape Expert and DOEE inspector, certifying that GAR landscape elements have been installed per the plan (see Appendix A).

Landscape element – Features designated in the regulation (11 DCMR Subtitle C § 602.9) that provide credit toward the GAR score.

Landscape Expert – See “Certified Landscape Expert.”

Lot – The land bounded by definite lines that, when occupied or to be occupied by a building or structure and accessory buildings, includes the open spaces required under this title. A lot may or may not be the land so recorded on the records of the Surveyor of the District of Columbia.

Lot occupancy – The percentage of the total area of a lot that is occupied by the total building area of all buildings and structures on the lot.

Permeable paving – A surface that facilitates water infiltration through paving material while providing a stable, load-bearing surface. Examples include pervious concrete, porous asphalt, perforated brick pavers, flexible porous paving (including porous rubber), and mechanically reinforced grass, but do not include grass or gravel.

Scoresheet – The document submitted within the submitted drawings that calculates the total GAR score for the site (see Appendix A).

Soil depth – The combined depth of uncompacted topsoil and subgrade.

Soil improvement specification – Specification for importing topsoil or amending disturbed topsoil, including texture, percent organic matter, pH, installation method, and incorporation method and rate.

Subgrade – The existing soil beneath the installed topsoil.

Temporary certificate of occupancy – May be granted by the Zoning Administrator when installation of the required landscaping is not currently possible due to weather, season, or site construction subject to the condition that the required landscaping must be installed within 4 months after the date the temporary certificate is issued.

Topsoil – The mineral and organic layer suitable to root growth, typically defined as the A horizon.

Vegetated roof – A horizontal or near-horizontal surface on top of a building or structure covered with vegetation and a growing media. Vegetated roofs are intended to promote water or energy conservation by using plants and soils to slow, filter, and infiltrate stormwater runoff. Vegetated roofs may be intensive or extensive, but are not limited to modular or layered growth systems.

Vegetated roof growing media – Growing media consists of 70%–80% inorganic material and a maximum 30% organic matter by volume. Growing media shall be capable of supplying all of the following in quantities sufficient to support plant growth: nutrient availability, water-holding capacity, drainage, structural support, and ballast.

Vegetated wall – A vertical or near-vertical surface covered with vegetation and, in some cases, a growing media. Vegetated walls may include but are not limited to walls or screens with climbing vines, espaliered trees, or modular planting systems.

Worksheet – The document submitted within the drawings that tabulate the landscape element square footages on each submitted page (see Appendix A).